

| | | | | | |
|---|--|--|--|---|-----------|
| 1. Report No. FHWA/LA-85/176 | | 2. Government Accession No. | | 3. Recipient's Catalog No. | |
| 4. Title and Subtitle RAPID CURING AND STRENGTH RELATIONSHIPS OF CONCRETE | | | | 5. Report Date May 1985 | |
| | | | | 6. Performing Organization Code | |
| 7. Author(s) Masood Rasoulia and Carl Burnett | | | | 8. Performing Organization Report No. 176 | |
| 9. Performing Organization Name and Address Louisiana Department of Transportation and Development Research and Development Section P. O. Box 94245 Capitol Station Baton Rouge, Louisiana 70804-9245 | | | | 10. Work Unit No. | |
| | | | | 11. Contract or Grant No. La. HPR Study No. 83-1C(B) | |
| 12. Sponsoring Agency Name and Address Louisiana Department of Transportation and Development Research and Development Section P. O. Box 94245 Capitol Station Baton Rouge, Louisiana 70804-9245 | | | | 13. Type of Report and Period Covered Final Report March 1983 - February 1985 | |
| | | | | 14. Sponsoring Agency Code | |
| 15. Supplementary Notes Conducted in cooperation with the U. S. Department of Transportation, Federal Highway Administration. | | | | | |
| 16. Abstract The rapid rate of construction has created a need to have information on the strength of concrete at the earliest possible time. Having to wait 28 days before the strength can be determined can cause serious problems if inferior concrete had been used in a member or a section which is already in place. In this study the ASTM C-684, making, accelerated curing, and testing of concrete compression test and specimens, was examined. Procedure A, the warm water method, and procedure B, the boiling water method, were evaluated using two types of coarse aggregate, locally available chert gravel and Kentucky limestone. Concrete cylinders were tested after being cured by each accelerated curing method and normal moist curing. The data from each accelerated method was plotted against the normally cured 28-day strength and the best fit curve was determined. Also, an equation was established for each procedure and each curve. From the data indicated in this report and literature searched, it seems that accelerated curing methods can be used reliably to estimate the actual 28-day strength. | | | | | |
| 17. Key Words Accelerated curing methods, estimated 28-day compressive strength, concrete mix design. | | | | 18. Distribution Statement Unrestricted. This document is available to the public through the National Technical Information Service, Springfield, Virginia 22161 | |
| 19. Security Classif. (of this report) Unclassified | | 20. Security Classif. (of this page) Unclassified | | 21. No. of Pages 43 | 22. Price |

RAPID CURING AND STRENGTH RELATIONSHIPS OF CONCRETE

Final Report

By

MASOOD RASOULIAN
CONCRETE RESEARCH ENGINEER

And

CARL BURNETT
RESEARCH ENGINEER-IN-TRAINING

Research Report No. 175

Research Project No. 83-1C(B)

Conducted by
LOUISIANA DEPARTMENT OF TRANSPORTATION
AND DEVELOPMENT
Research and Development Section
In Cooperation with
U. S. Department of Transportation
FEDERAL HIGHWAY ADMINISTRATION

"The contents of this report reflect the views of the authors who are responsible for the facts and the accuracy of the data presented herein. The contents do not necessarily reflect the official views or policies of the State or the Federal Highway Administration. This report does not constitute a standard, specification, or regulation."

MAY 1985

ABSTRACT

The rapid rate of concrete construction has created a need to have information on the strength of concrete at the earliest possible time. Having to wait 28 days before the design strength can be determined may cause serious problems if inferior concrete had been used in a member or a section which is already in place. The use of an accelerated strength test would give the engineer valuable information for quality control. In this study the ASTM procedure C-684, Making, Accelerated Curing, and Testing of Concrete Compression Test Specimens, procedure A, warm water method, and procedure B, boiling water method, were evaluated using two types of coarse aggregate, locally available chert gravel and Kentucky limestone. Thirty mixes were prepared for both groups. Compressive strength cylinders were tested after being cured by each accelerated curing method and by standard moist curing. The data from each accelerated method was plotted against the normally cured 28-day strength and the best fit curve was determined using a least square linear regression. The equation of this curve for the gravel group is $y = 1.16x + 2519$ for procedure A and $y = 1.05x + 2140$ for procedure B. For the limestone group the equation is $y = 1.7x + 1558$ for procedure A and $y = 1.7x + 1124$ for procedure B. In these equations y is the 28-day strength and x is the accelerated curing strength. By determining the accelerated curing strength the equation can be solved for y , which is the estimated 28-day strength. Also, the predicted 28-day strength could be directly determined from the graphs.

Based on the information obtained in this report and a literature search, it seems that the accelerated curing method can be used reliably to estimate the actual 28-day strength.

The findings of this study will be reviewed by the Department's Structures and Hydraulics Project Advisory Committee. Based on their favorable recommendation, it is anticipated that the correlations developed in this report will be implemented on large-scale concrete construction projects, where, due to the schedule of the construction, there is an urgent need for early determination of concrete strength. On such a project deficiencies could be checked and modified, eliminating the need to wait 28 days to verify design strength.

METRIC CONVERSION FACTORS*

| <u>To Convert from</u> | <u>To</u> | <u>Multiply by</u> |
|----------------------------|---|------------------------------|
| <u>Length</u> | | |
| foot | meter (m) | 0.3048 |
| inch | millimeter (mm) | 25.4 |
| yard | meter (m) | 0.9144 |
| mile (statute) | kilometer (km) | 1.609 |
| <u>Area</u> | | |
| square foot | square meter (m ²) | 0.0929 |
| square inch | square centimeter (cm ²) | 6.451 |
| square yard | square meter (m ²) | 0.8361 |
| <u>Volume (Capacity)</u> | | |
| cubic foot | cubic meter (m ³) | 0.02832 |
| gallon (U.S. liquid)** | cubic meter (m ³) | 0.003785 |
| gallon (Can. liquid)** | cubic meter (m ³) | 0.004546 |
| ounce (U.S. liquid) | cubic centimeter (cm ³) | 29.57 |
| <u>Mass</u> | | |
| ounce-mass (avdp) | gram (g) | 28.35 |
| pound-mass (avdp) | kilogram (kg) | 0.4536 |
| ton (metric) | kilogram (kg) | 1000 |
| ton (short, 2000 lbs) | kilogram (kg) | 907.2 |
| <u>Mass per Volume</u> | | |
| pound-mass/cubic foot | kilogram/cubic meter (kg/m ³) | 16.02 |
| pound-mass/cubic yard | kilogram/cubic meter (kg/m ³) | 0.5933 |
| pound-mass/gallon (U.S.)** | kilogram/cubic meter (kg/m ³) | 119.8 |
| pound-mass/gallon (Can.)** | kilogram/cubic meter (kg/m ³) | 99.78 |
| <u>Temperature</u> | | |
| deg Celsius (C) | kelvin (K) | $t_k = (t_c + 273.15)$ |
| deg Fahrenheit (F) | kelvin (K) | $t_k = (t_f + 459.67) / 1.8$ |
| deg Fahrenheit (F) | deg Celsius (C) | $t_c = (t_f - 32) / 1.8$ |

*The reference source for information on SI units and more exact conversion factors is "Metric Practice Guide" ASTM E 380.

**One U.S. gallon equals 0.8327 Canadian gallon.

TABLE OF CONTENTS

| | |
|--|-----|
| ABSTRACT ----- | iii |
| IMPLEMENTATION STATEMENT ----- | v |
| METRIC CONVERSION FACTORS ----- | vi |
| LIST OF TABLES ----- | ix |
| LIST OF FIGURES ----- | xi |
| INTRODUCTION ----- | 1 |
| PURPOSE AND SCOPE ----- | 2 |
| METHODOLOGY ----- | 3 |
| DISCUSSION OF RESULTS ----- | 5 |
| How to Use Accelerated Strength Curves ----- | 11 |
| CONCLUSIONS AND RECOMMENDATIONS ----- | 13 |
| BIBLIOGRAPHY ----- | 14 |
| APPENDIX A ----- | 15 |
| APPENDIX B ----- | 35 |
| ADDENDUM ----- | 41 |

| | | |
|---|--|----|
| 1 | Gravel Group | 32 |
| 3 | Mix Design and Plastic Concrete Data - Limestone Group | 33 |
| 4 | Listing of Compressive Strengths in PSI - Limestone Group | 34 |
| 5 | Mix Factor Data | 42 |

LIST OF FIGURES

| <u>Figure No.</u> | | <u>Page No.</u> |
|-------------------|--|-----------------|
| 1 | Placement of a Concrete Cylinder in the Curing Tank ----- | 4 |
| 2 | Curing Tank Used in This Study ----- | 4 |
| 3 | Curve for Estimating the 28-day Strength by Procedure A, Gravel Group ----- | 6 |
| 4 | Curve for Estimating the 28-day Strength by Procedure B, Gravel Group ----- | 7 |
| 5 | Curve for Estimating the 28-day Strength by Procedure A, Limestone Group ----- | 8 |
| 6 | Curve for Estimating the 28-day Strength by Procedure B, Limestone Group ----- | 9 |
| 7 | Curve for Estimating the 3-day Strength by Procedure A, Gravel Group ----- | 17 |
| 8 | Curve for Estimating the 3-day Strength by Procedure B, Gravel Group ----- | 18 |
| 9 | Curve for Estimating the 7-day Strength by Procedure A, Gravel Group ----- | 19 |
| 10 | Curve for Estimating the 7-day Strength by Procedure B, Gravel Group ----- | 20 |
| 11 | Curve for Estimating the 14-day Strength by Procedure A, Gravel Group ----- | 21 |
| 12 | Curve for Estimating the 14-day Strength by Procedure B, Gravel Group ----- | 22 |
| 13 | Curve for Estimating the 21-day Strength by Procedure A, Gravel Group ----- | 23 |
| 14 | Curve for Estimating the 21-day Strength by Procedure B, Gravel Group ----- | 24 |
| 15 | Curve for Estimating the 7-day Strength by Procedure A, Limestone Group ----- | 25 |
| 16 | Curve for Estimating the 7-day Strength by Procedure B, Limestone Group ----- | 26 |

LIST OF FIGURES (CONTINUED)

| <u>Figure No.</u> | | <u>Page No.</u> |
|-------------------|---|-----------------|
| 17 | Curve for Estimating the 14-day Strength by Procedure B, Limestone Group ----- | 27 |
| 18 | Curve for Estimating the 14-day Strength by Procedure B, Limestone Group ----- | 28 |
| 19 | Curve for Estimating the 21-day Strength by Procedure A, Limestone Group ----- | 29 |
| 20 | Curve for Estimating the 21-day Strength by Procedure B, Limestone Group ----- | 30 |
| 21 | 28-day Strength Versus Mix Factor ----- | 43 |

INTRODUCTION

Developments in the rapid placement of concrete have caused a need for improvement in quality assurance procedures such as knowing the potential strength of concrete at the earliest possible time after the concrete has been placed. High capacity concrete plants, transit mixer trucks, prefabricated forms, slip-form construction, power vibrators, finishing equipment and concrete pumps have enabled the contractors to place and finish large quantities of concrete (as much as 120 to 400 cubic yards per hour). By the time 28-day compressive strength tests are obtained from the initial pours, many additional days of production have been placed. Problems stemming from the initial mix design could remain undetected and might be repeated in successive pours, which could lead to serious consequences. Therefore, the use of reliable accelerated strength test data would give the engineers valuable information to control the quality of concrete and make the desired changes sooner.

ASTM has standardized three methods for predicting the 28-day compressive strength of concrete. These methods are the (a) warm water method, (b) boiling water method, and (c) autogenous method. The 28-day compressive strength can be predicted with accelerated curing cylinders in less than two days by the (a) and (b) methods. This research was initiated to evaluate the warm water and boiling water methods and to establish relationships for estimating the 28-day concrete strength soon after pouring. The autogenous method was not evaluated in this study.

PURPOSE AND SCOPE

The specific aims of this research study were:

1. To determine the feasibility of using accelerated testing for the prediction of concrete strength (28 days and earlier).
2. To evaluate several test methods available.
3. To establish correlation curves for each material evaluated and also each test method evaluated.

The scope of this project was limited to laboratory evaluation of accelerated curing techniques indicated in ASTM procedure C-684, "Making, Accelerated Curing, and Testing of Concrete Compression Test Specimens," procedures A and B. Two types of coarse aggregates, river gravel and limestone, were used in this study.


METHODOLOGY

There were two types of coarse aggregate evaluated in this study, chert gravel and limestone. The chert gravel was obtained locally and limestone was imported from Kentucky. The same type of fine aggregate was used for all mixes. Mix designs were set up to exhibit a wide range of strengths in order to establish a strength curve for each material. Variables affecting the strength, such as cement content, water-cement ratio (w/c) and air content, were used to obtain a range of strengths. Also, air entraining agents, water and super water reducers were used to adjust the strength and workability of the mixes. There were thirty mixes for the gravel group and thirty mixes for the limestone group. The cement content varied from 4 to 7.5 bags per cubic yard of concrete (376 lbs to 705 lbs) and water-cement ratios of 0.75 to 0.35, respectively. Mix design for the gravel and limestone mixes along with the slump, air content and unit weight which were determined during the mixing operation are indicated in Table 1 and Table 3 (Appendix A). For each mix four 6-inch by 12-inch cylinders were made to be cured and tested in accordance with ASTM C-684, procedure A. Four more 6-inch by 12-inch cylinders were made for procedure B. Additionally, cylinders were cast and cured conventionally in the moist room and tested at 3 days, 7 days, 14 days, 21 days and 28 days.

The specimens were cast in steel molds for procedure A and were immediately placed in the curing tank for a period of 23-1/2 hours \pm 30 minutes. The curing tank water temperature was 95 \pm 5°F. The tops of the molds were covered to prevent loss of the mortar to the water bath. Figure 1 shows a laboratory technician placing a concrete cylinder in the curing tank. A long handle was used to avoid injury to the hand by the hot water. For procedure B, the cylinders were cast in steel molds and were cured initially for 23 hours in the laboratory environment (approximate temperature 72°F). The cylinders were then placed in boiling water and remained there for a period of 3-1/2 hours before testing. Figure 2 shows the tank used in this study.

*Placement of a Concrete Cylinder
in the Curing Tank*

FIGURE 1

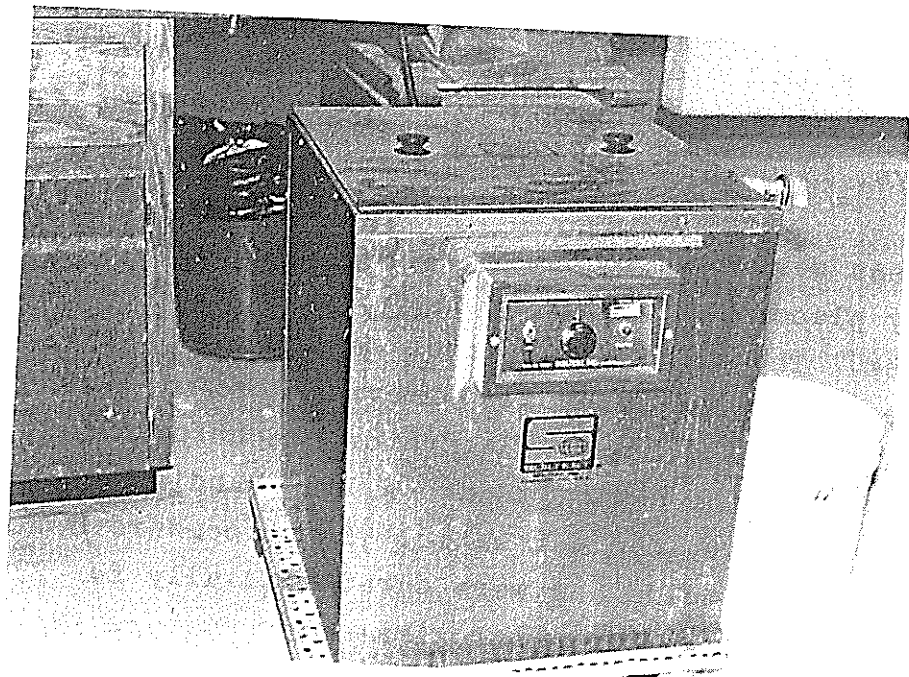

Curing Tank Used in This Study


FIGURE 2

DISCUSSION OF RESULTS

The compressive strength of each accelerated method was examined with respect to the corresponding 3, 7, 14, 21 and 28-day strength of moist cured cylinders. A least square linear regression with 95% confidence level was used to determine the best fit. The Department's Statistical Analysis System (SAS computer program) general linear model procedures was used for this purpose. The equation of the best fit curve in the form of $y = a_0x + a_1$ was established for each age by procedure A and procedure B. In this format the dependent variable y was the compressive strength of normally cured cylinders and independent variable x was the strength of the accelerated curing cylinders; a_0 and a_1 were the constants determined for each equation.

The correlation curve for the 28-day strength data for procedures A and B, gravel group, are depicted in Figures 3 and 4, respectively. The same information is depicted in Figures 5 and 6 for the limestone group. The curves for 3, 7, 14 and 21 are shown in Figures 7 through 14 for the gravel group and in Figures 15 through 20 for the limestone in Appendix A. No 3-day correlation was established for the limestone group. These curves could be used as a check point during concrete construction and initial phases of using accelerated curing methods. For example, if the predicted strength of 14 or 21-day-old concrete matches the actual strength at the same age, more reliability can be placed on the 28-day strength curve.

For each curve a correlation coefficient is calculated. This coefficient indicates the fit of the curve to the plotted points. A correlation coefficient of 1.00 would indicate a perfect fit. Also, for each curve the upper and the lower limit of the 95% confidence levels, standard error of estimate and the number of data points used are presented.

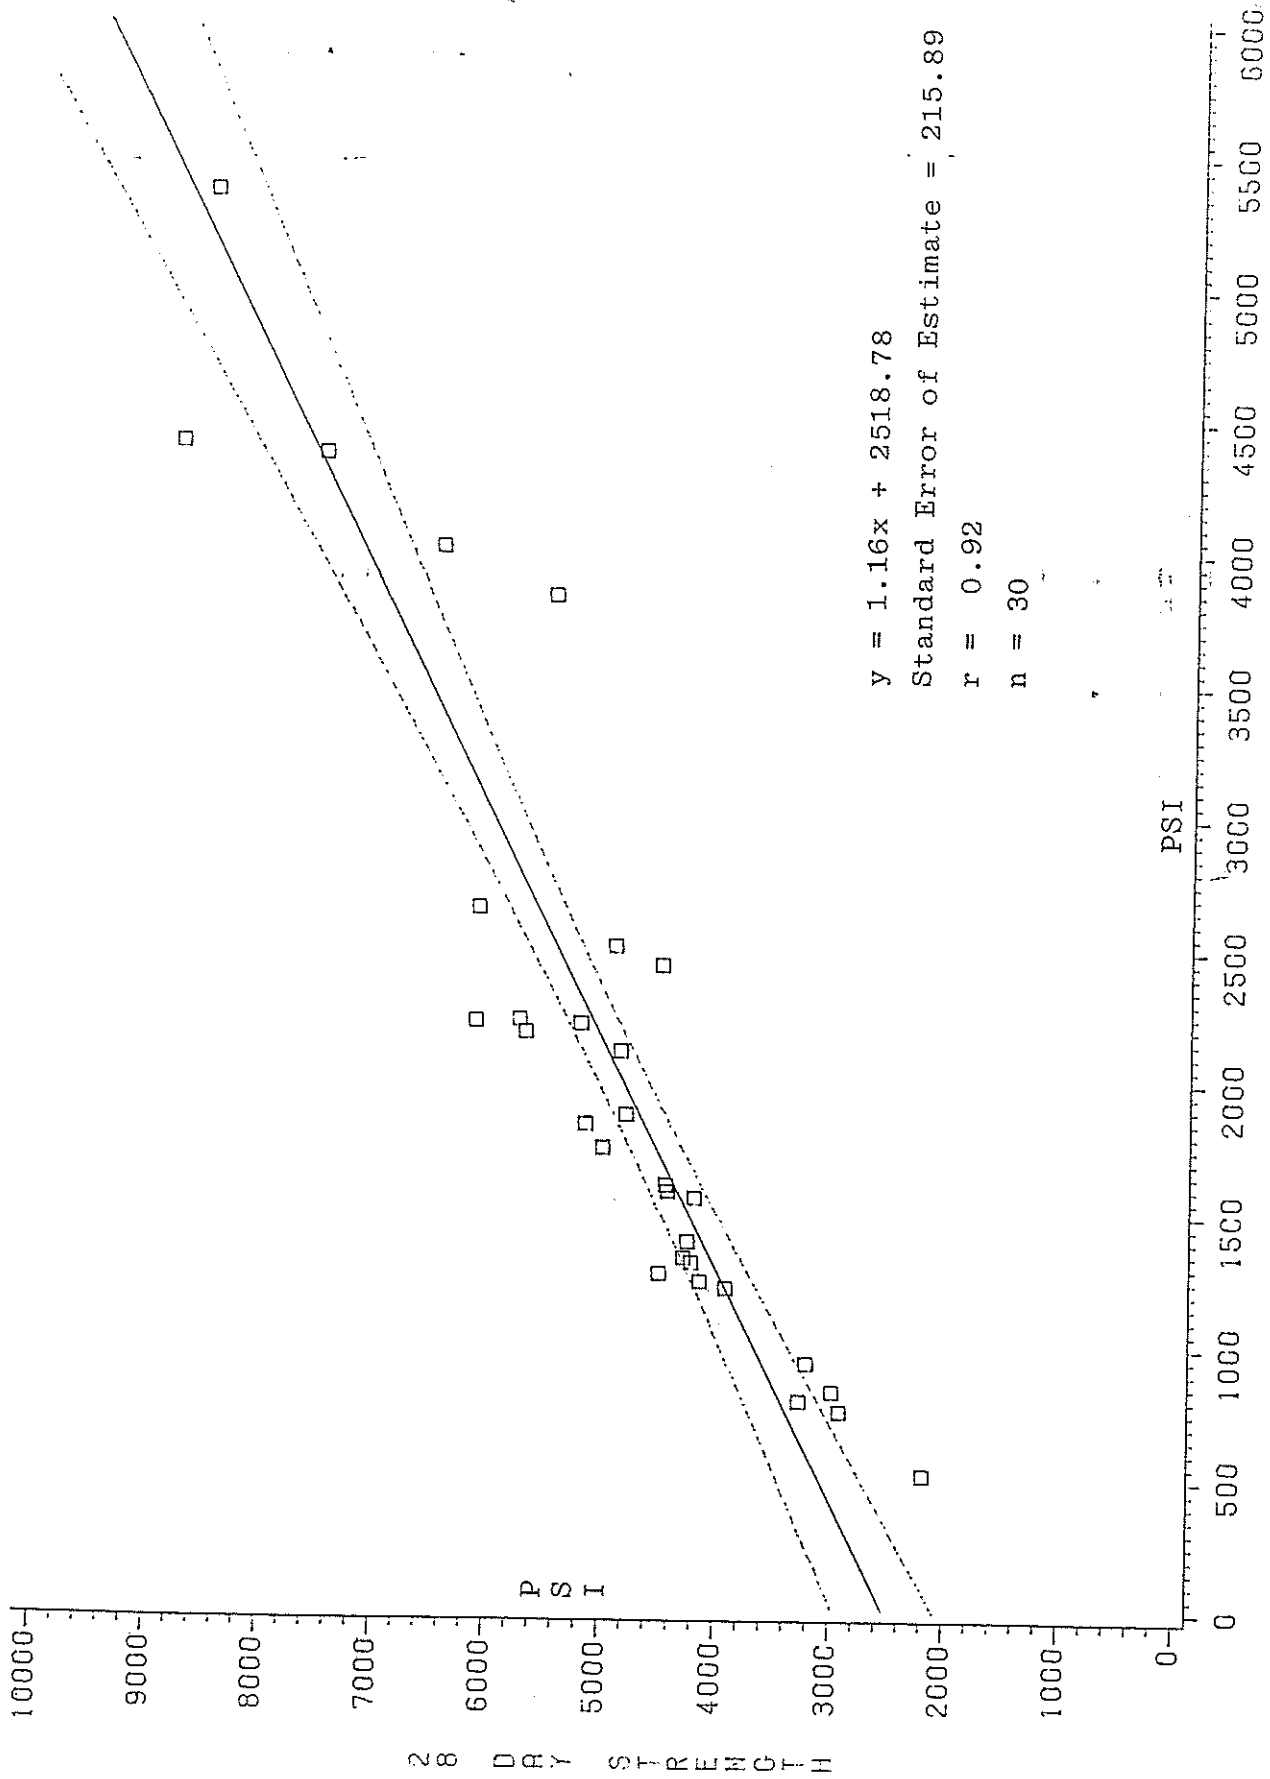

28 DRY STRENGTH

PSI

PROCEDURE A

PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

FIGURE 3



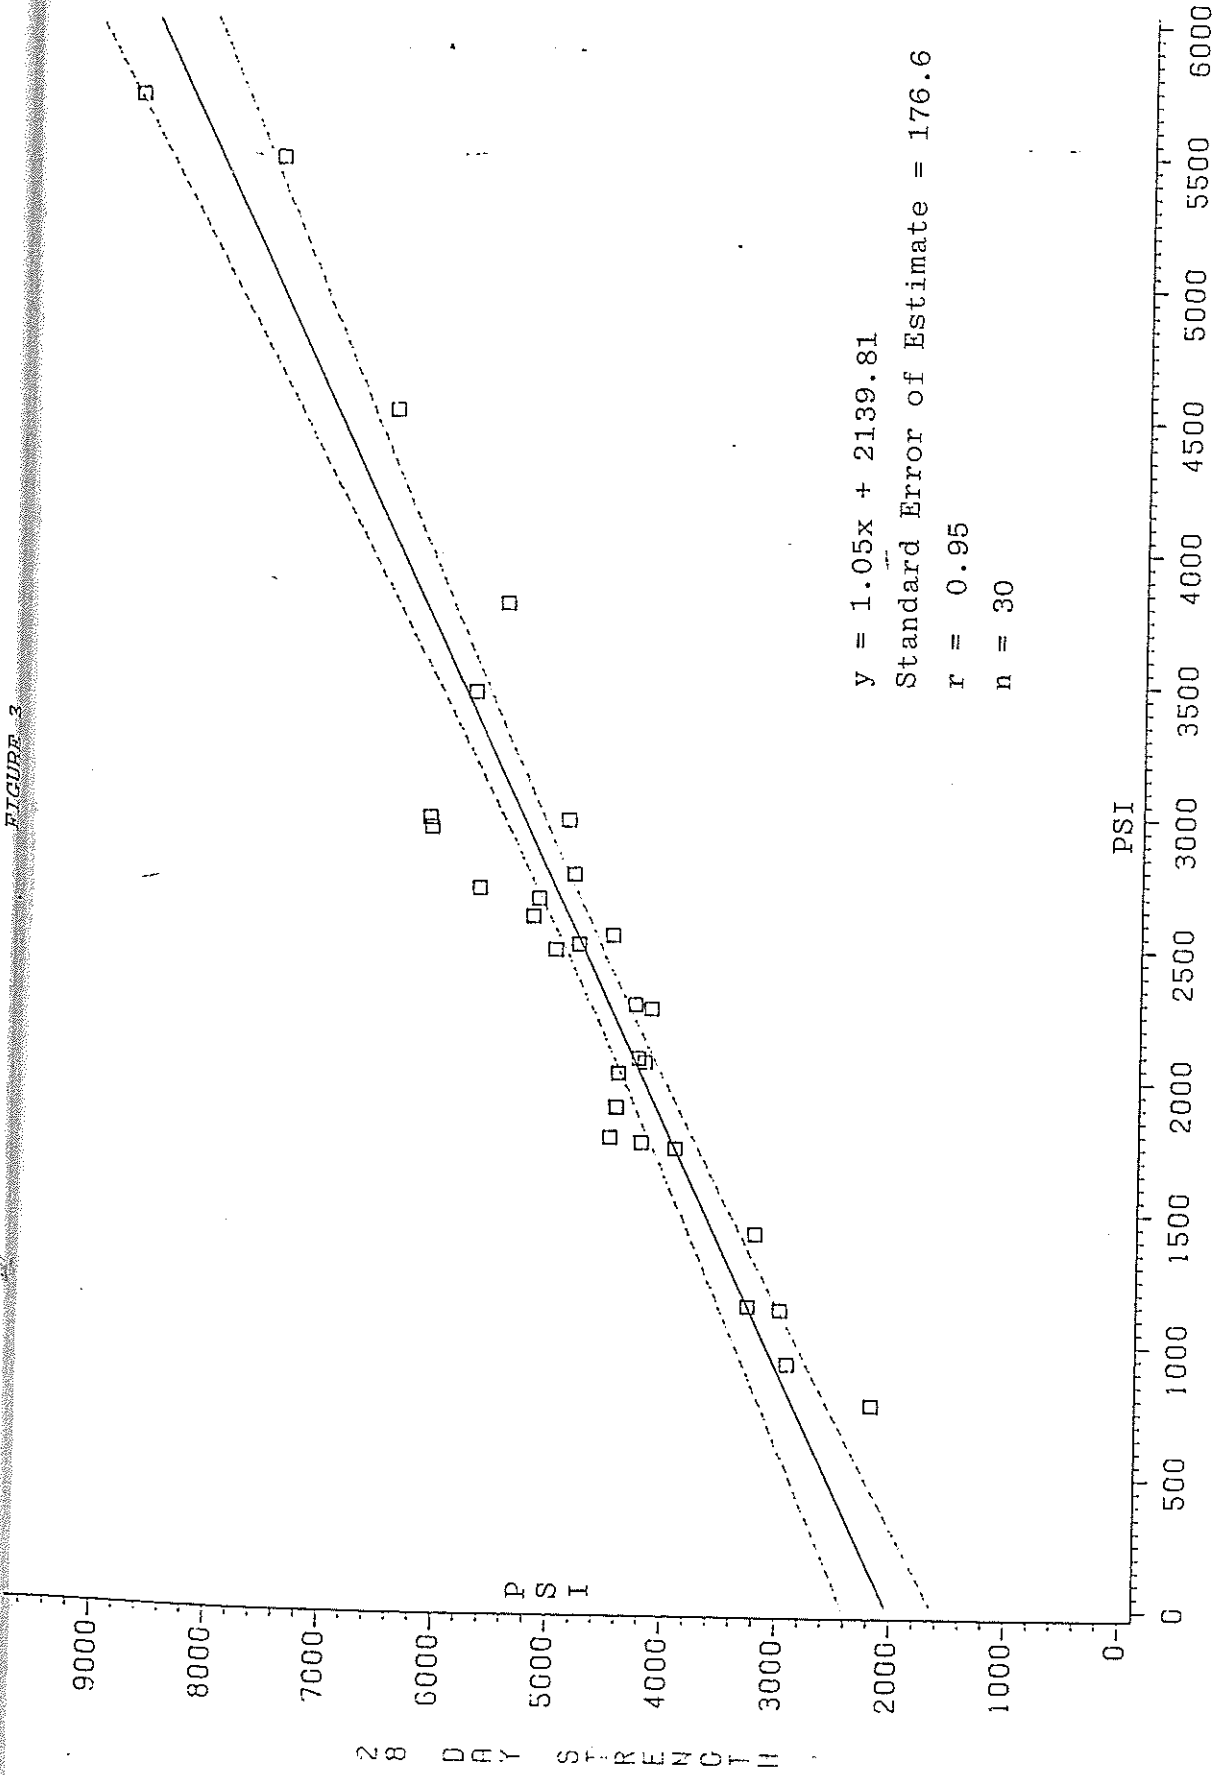


FIGURE 4
PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

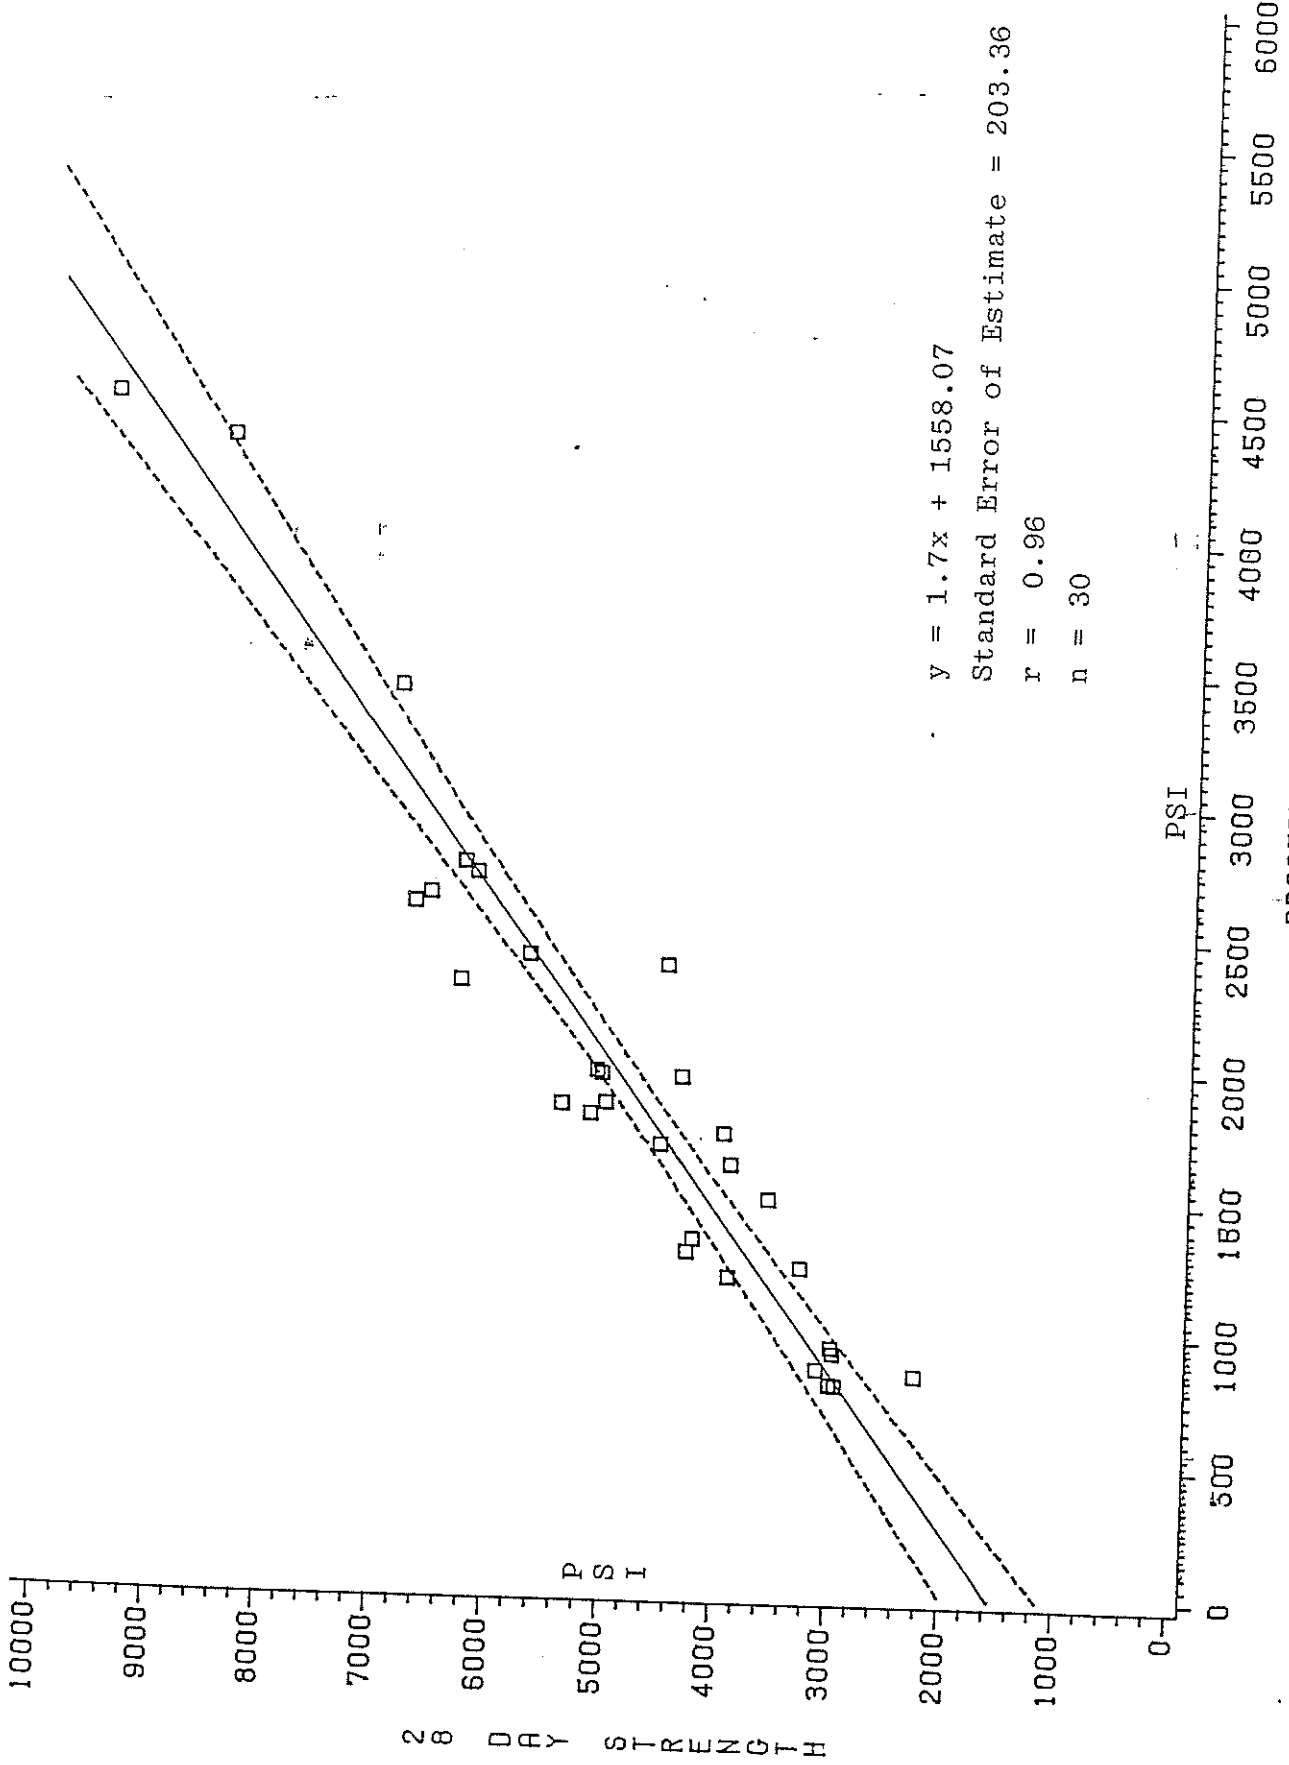

PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)
 PROCEDURE A

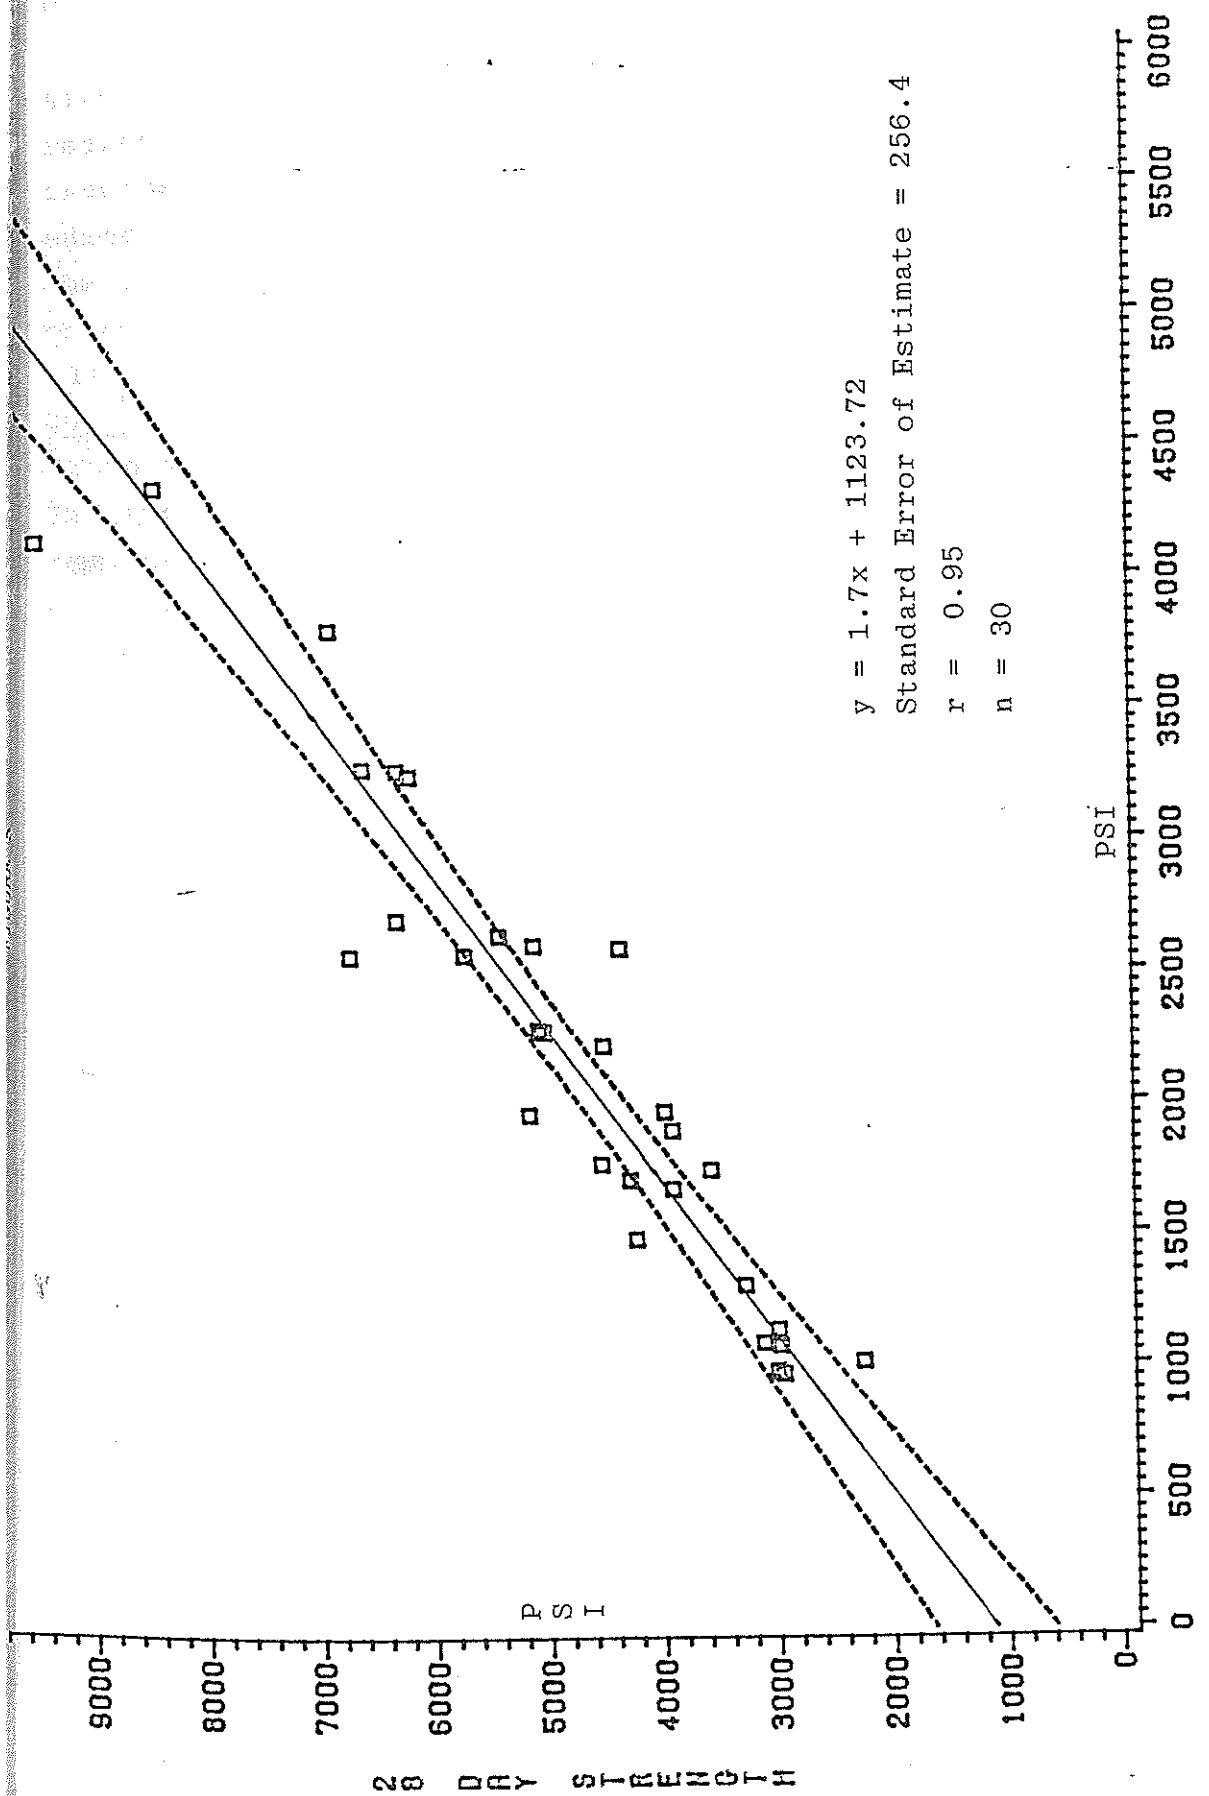

PROCEDURE B
 PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)

FIGURE 6

Both procedures evaluated can be used to predict the strength of concrete. There is no conclusion in this study that could indicate one is more accurate over the other one; however, the procedures in using each technique differ and are dependent on the job situation. Procedure A requires immediate placement in the warm water ($95 \pm 5^\circ\text{F}$) and curing for $23\text{-}1/2 \pm 30$ minutes prior to testing. This would require that the curing tank be available at the job site. If this cannot be done, procedure B can be used. The specimens are allowed to be air cured initially for 23 hours before the start of curing; this way the cylinders could be brought to the laboratory, cured and tested. In procedure B the samples were placed in boiling water and remained there for a period of $3\text{-}1/2$ hours. All of the concrete cylinders placed in the curing tank were cast in reusable steel molds.

An attempt was also made to establish a direct correlation between the cement content, the amount of water used and the 28-day strength of concrete using the data from the mixes that were produced in this study and also similar mixes from other research projects. The intent of this correlation was to predict the strength of concrete based on water cement ratio and cement content. For more information see the Addendum, page . Also, ACI Committee 214 report "Use of Accelerated Strength Testing" is included in Appendix B. Guidelines indicated in the ACI-214 report were used to develop the information contained in this report and can be used to develop such relationships with different types of cement (or even different shipments of cement), pozzolans or aggregates.

The equipment used in this study is commercially available and it is relatively inexpensive or it can be built locally. Using simple precautions and appropriate tools, no safety hazard such as burns due to steam or boiling water can occur.

Although it is not expected that the accelerated strength be a replacement for the actual strength, it is felt that the efforts involved in predicting the 28-day strength are well worth the knowledge that is obtained. This knowledge is particularly important to the contractors to check the strength of concrete to avoid penalties or possible rebuilding.

How To Use Accelerated Strength Curves

The following steps are needed to use the graphs available in this report to predict the strength of concrete in the construction projects at the desired age.

1. Determine which accelerated method will be used. Procedure A requires the specimen to be immediately submerged in the curing tank after casting. This requires that the curing tank be available at the job site. If this cannot be done, use procedure B, which allows the specimens to be cured initially for 23 hours before the start of curing. This way the cylinder could be brought to the laboratory, cured and tested.
2. Cast the four 6-inch by 12-inch cylinders in watertight steel molds according to the standard procedures and record the type of coarse aggregate used.
3. Cure and test concrete cylinders according to the ASTM C-684 procedure. Record the compressive strength and the procedures used (procedure A or procedure B).
4. Go to the appropriate graph for the type of coarse aggregate used and the selected age. Locate the accelerated strength in the horizontal axis and read the compressive strength using the solid line curve. The value obtained is

the approximate value for the compressive strength at the selected age. A range could also be established using the upper and the lower 95 percent confidence levels. The actual strength should be in this range.

If the value indicated in the predicted strength is lower than the minimum strength specified in the design, adjustments should be made to correct the problem.

The curves indicated in this report are not thoroughly field tested and were developed using laboratory-made mixes. However, in order to validate the data obtained the equation $y = 1.05(x) + 2139.8$, where y is the predicted 28-day compressive strength and x is the accelerated curing strength, was used in checking the compressive strength of the concrete in two different paving projects. The results indicated the actual 28-day strengths were within 1 percent to 16 percent of the predicted values.

CONCLUSIONS AND RECOMMENDATIONS

The following conclusions have been reached in this study:

1. The equipment used in determining the accelerated curing method is relatively inexpensive or can be built locally. No safety hazards such as burns due to the steam or boiling water should occur using simple precautions.
2. Both procedures evaluated in this study can be used for estimating the strength of concrete at the design age. However, conditions at the job site dictate the type of procedure to be used.
3. Although it is not expected that accelerated strength be a replacement for the actual strength, it is felt that the efforts involved in predicting the 28-day strength should provide valuable information for the quality control of concrete placement.

It is recommended that the Department use the accelerated curing method developed in this study in one of its construction projects to check the actual 28-day strength using the accelerated curing strength. Based on the level of confidence obtained, the contractor could use the curves in this study as a quality control tool or develop his own curve using the concrete used in that construction project.

BIBLIOGRAPHY

1. American Concrete Institute Publication SP-56, "Accelerated Strength Testing," 1978.
2. American Concrete Institute, Committee 214, "Use of Accelerated Strength Testing," Concrete International, 1984.
3. "Concrete and Mineral Aggregate," Annual Book of ASTM Standards Part 14, 1983.
4. Lamond, Joseph F., "Quality Assurance Using Accelerated Strength Testing," Concrete International, 1983.
5. Malhotra, V. M., Highlights of ACI Standard 214-77, "Recommended Practice for Evaluation of Strength Test Results of Concrete," Concrete International, 1981.


d

s,

ch


ed

APPENDIX A

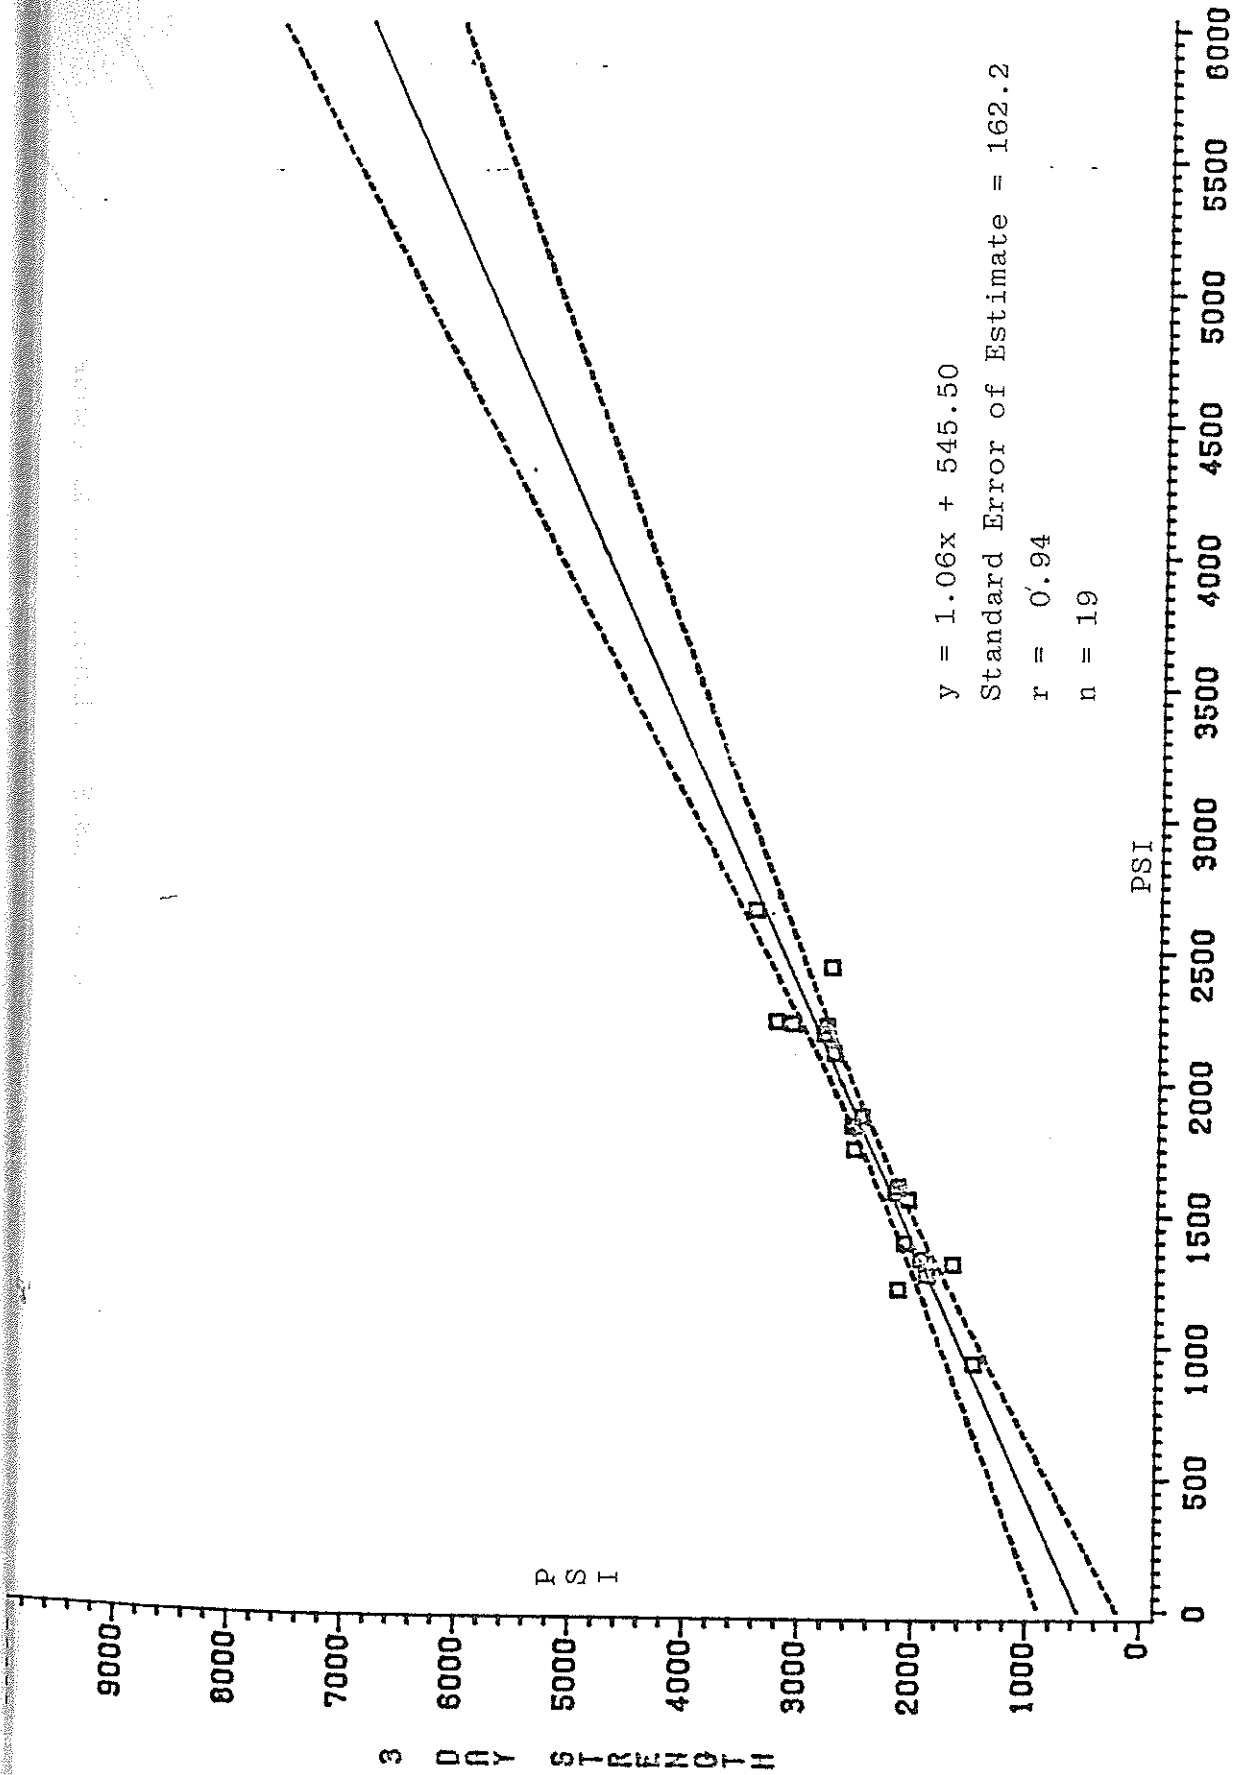


PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

FIGURE 7

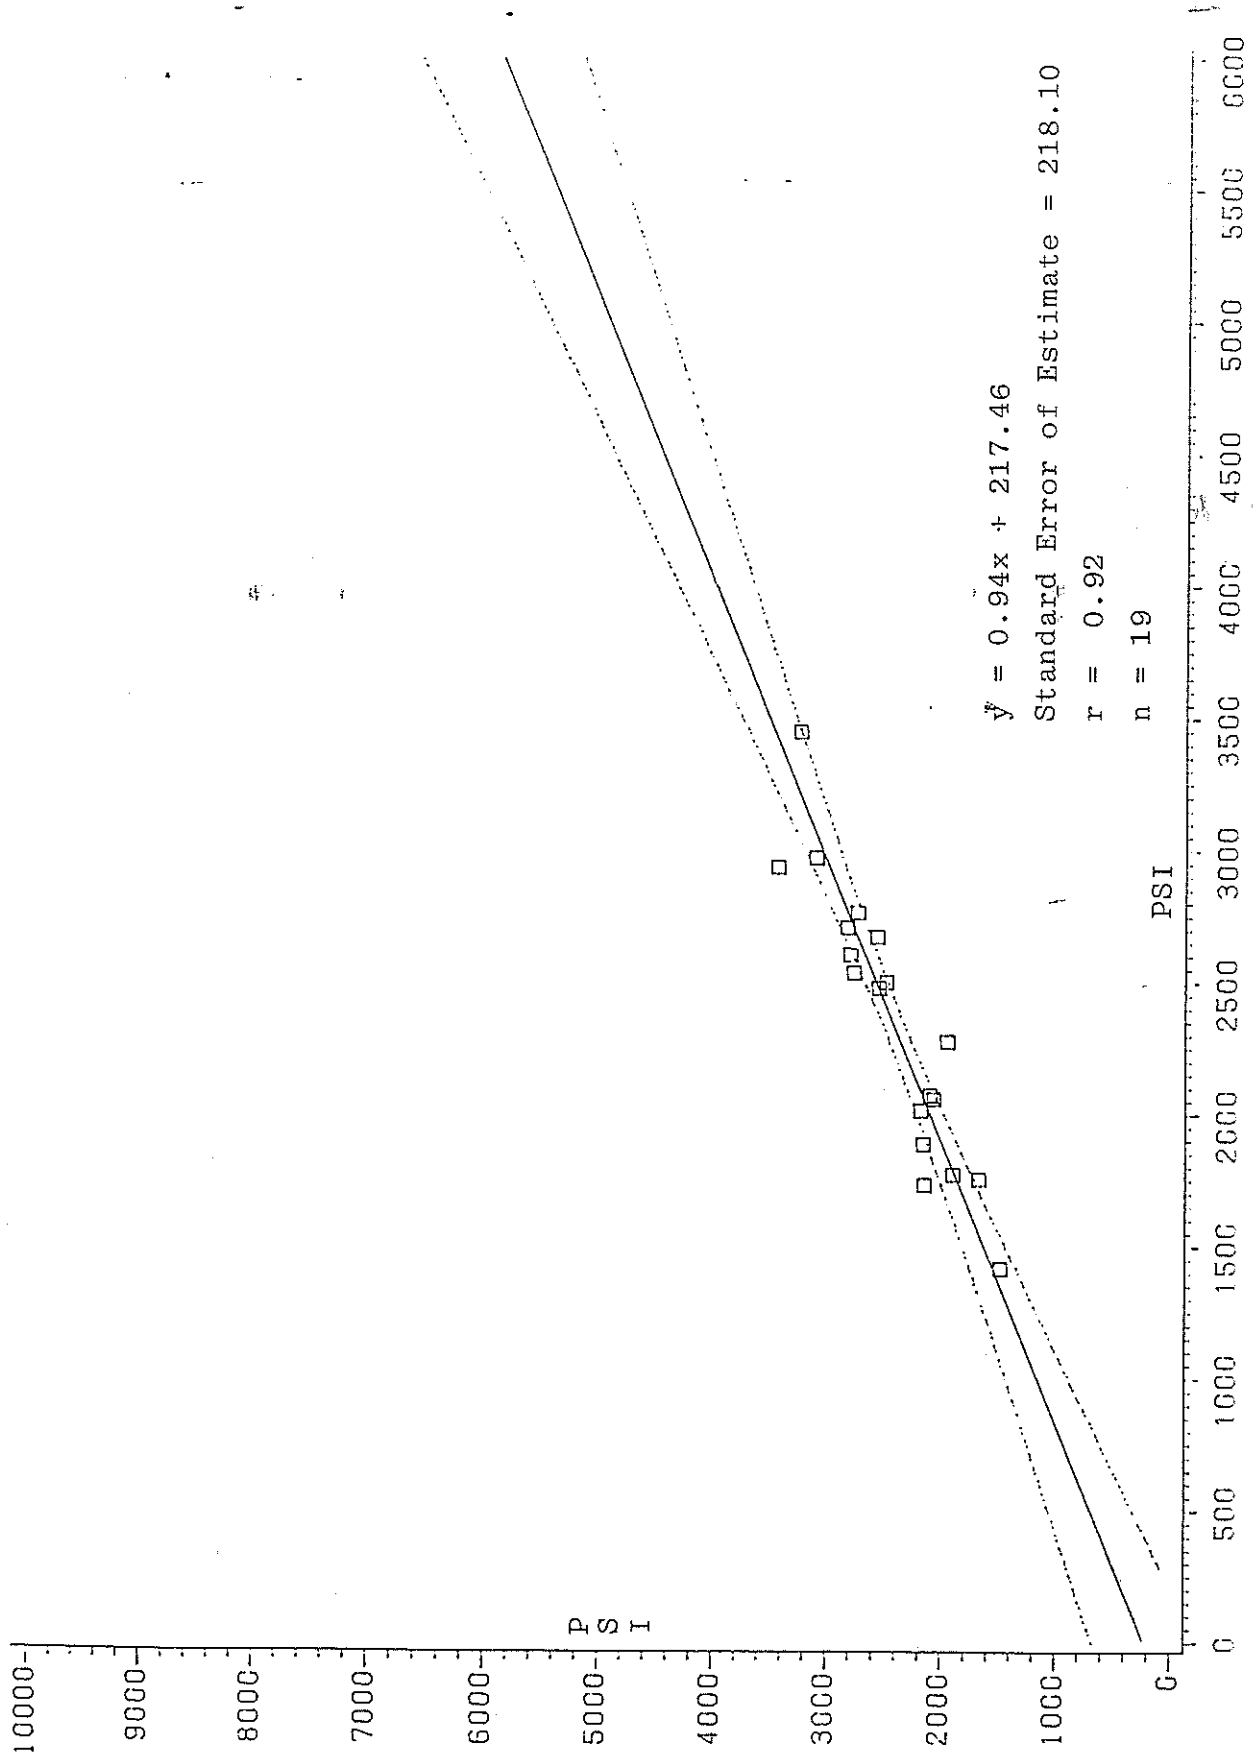


PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

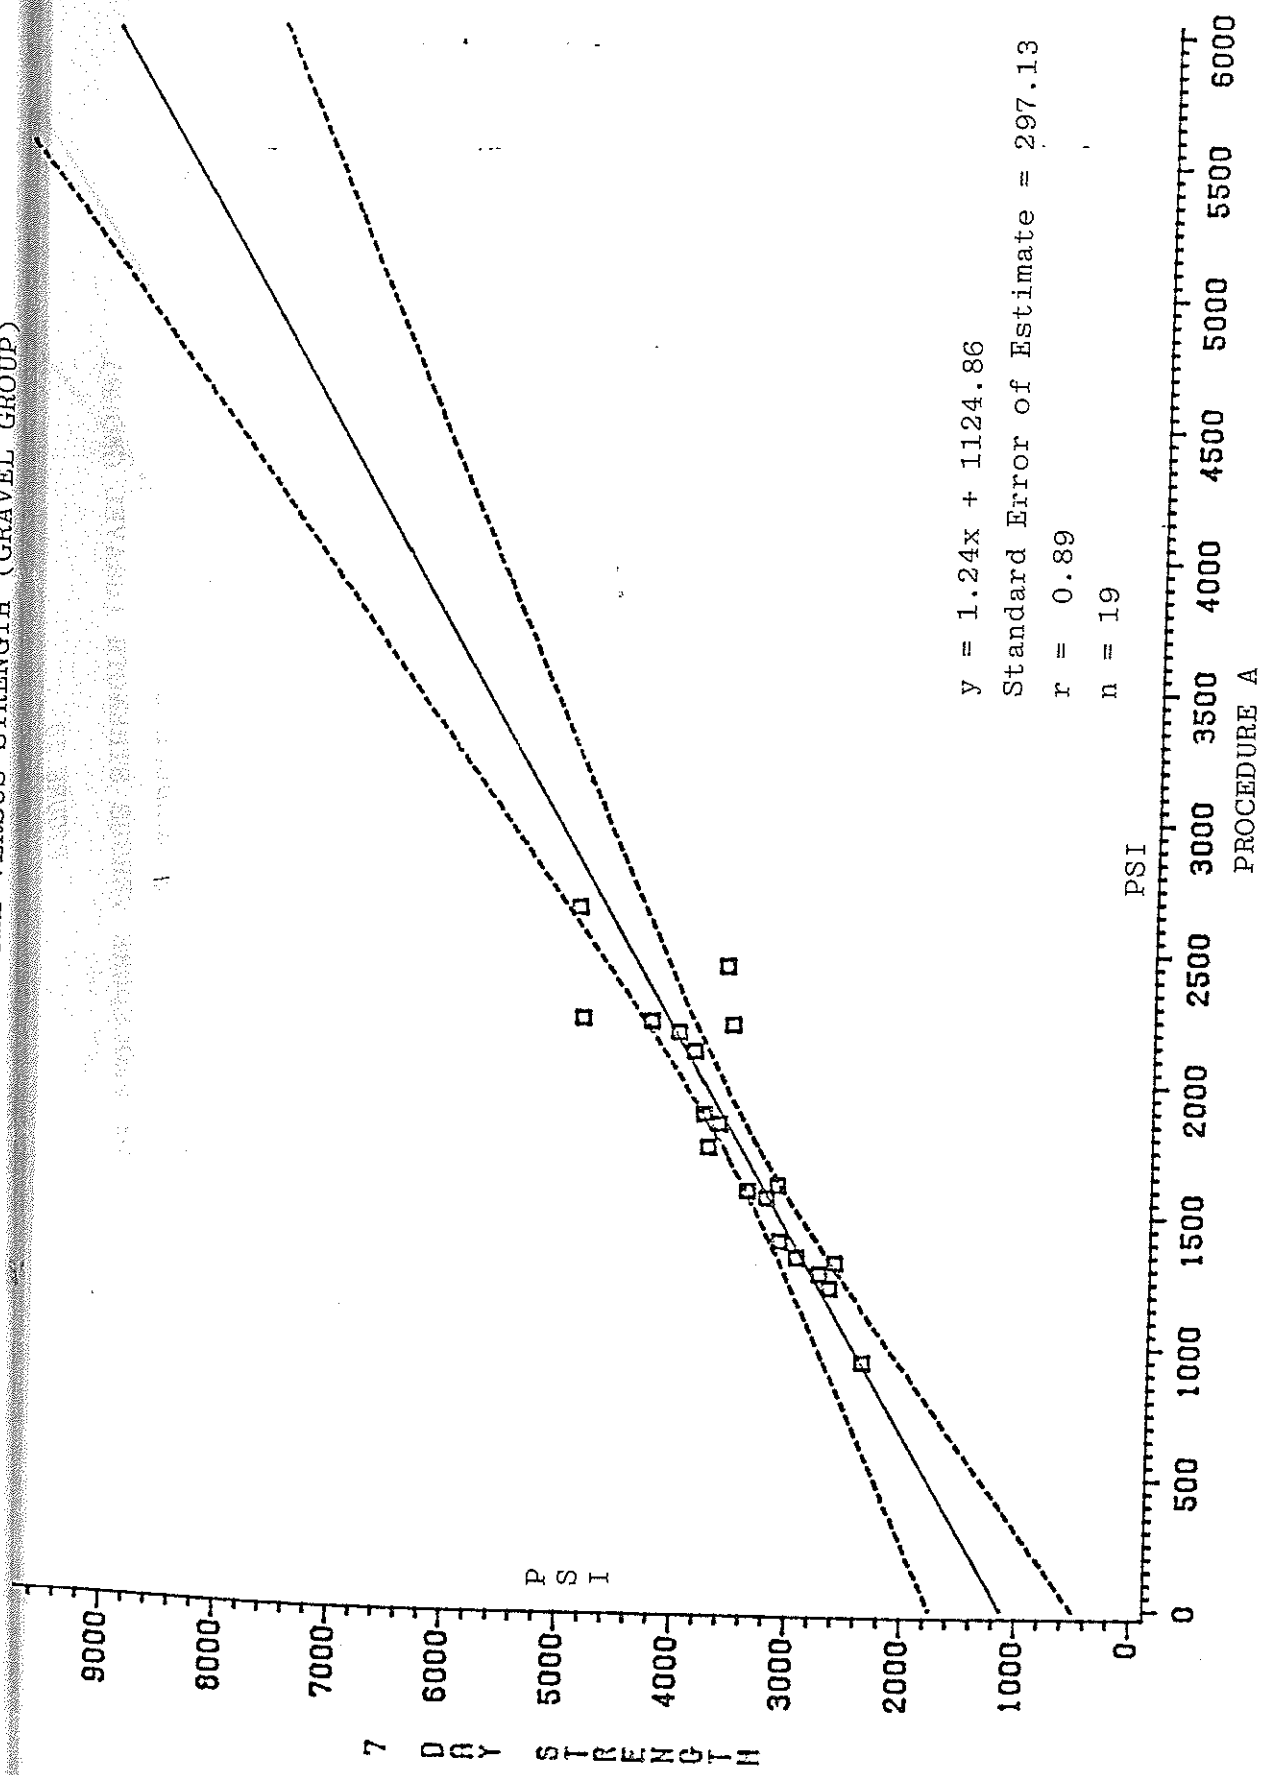

PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

FIGURE 9

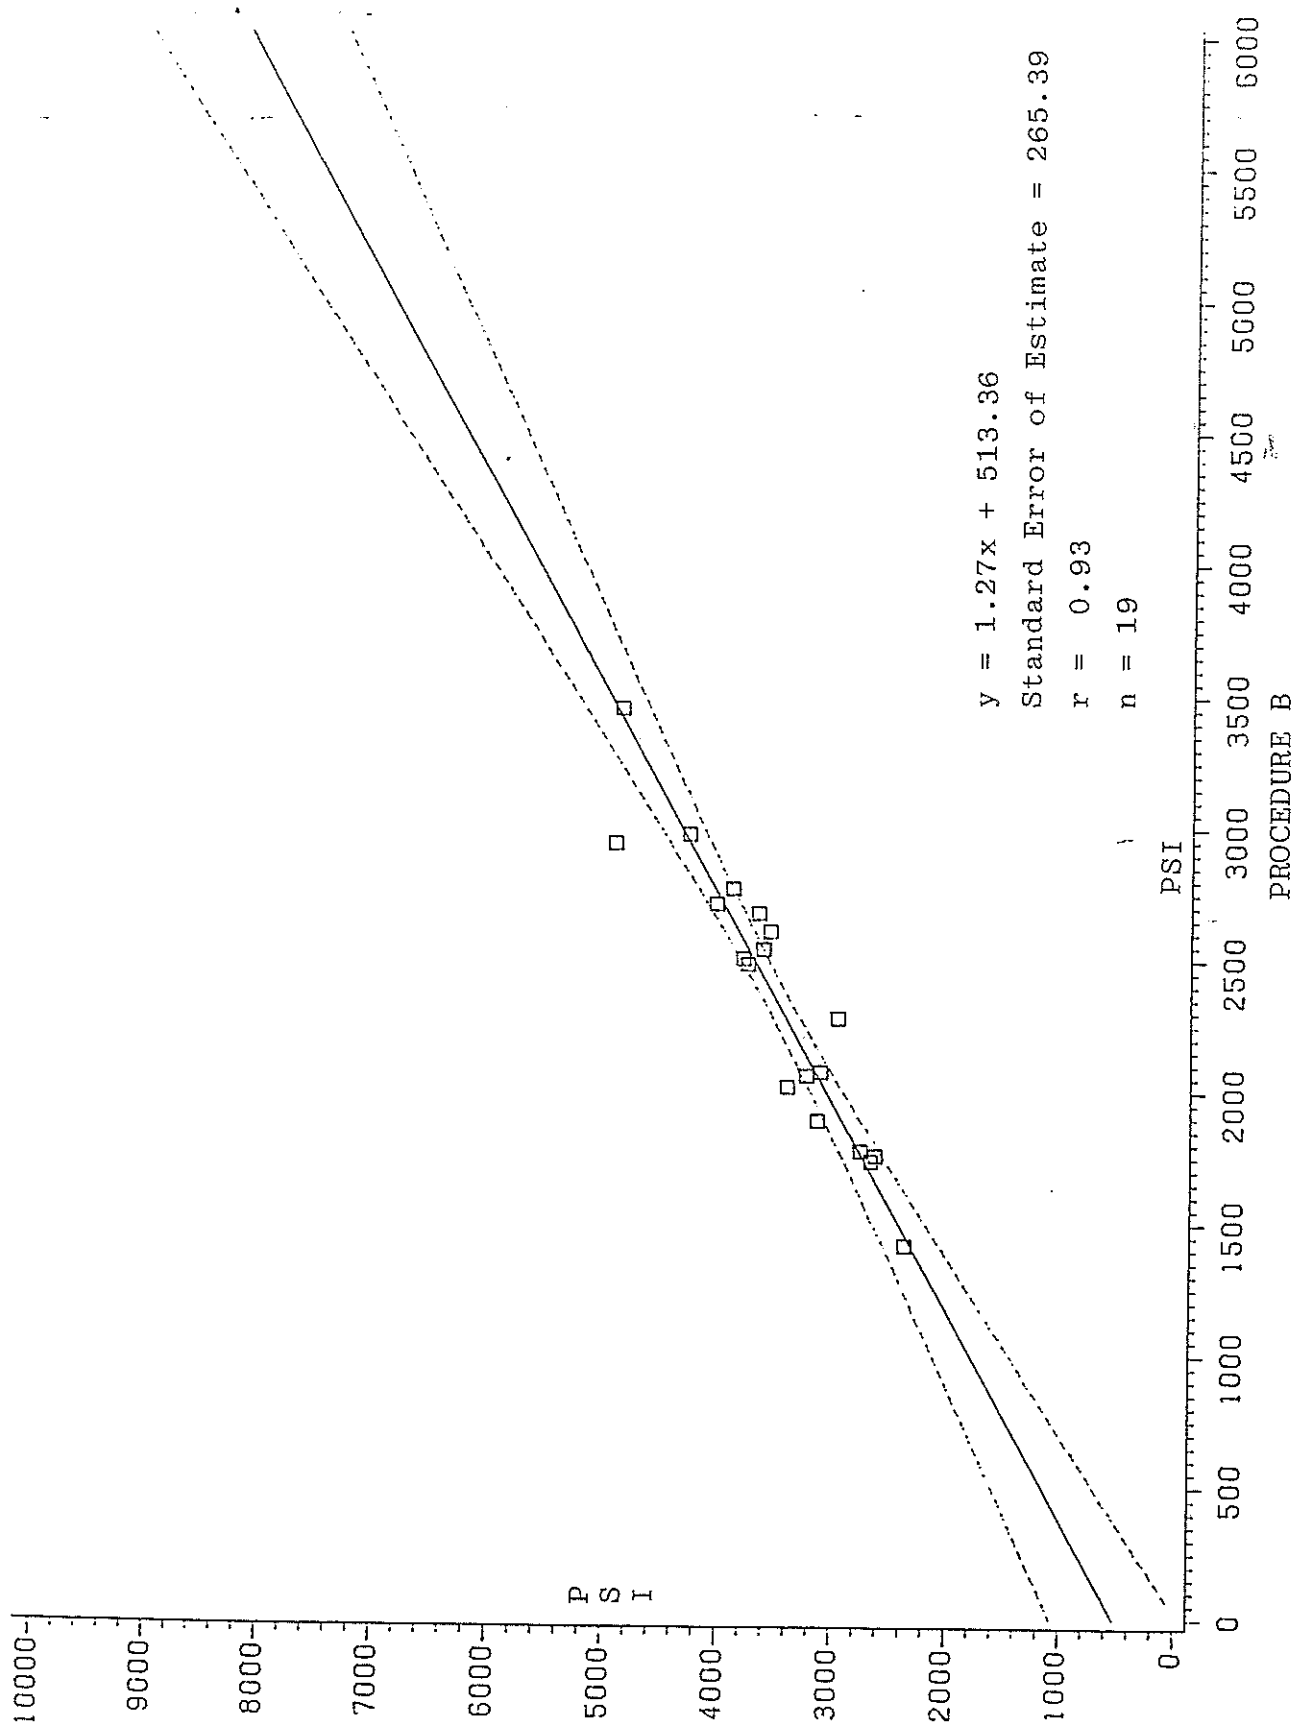

7 DAY STRENGTH


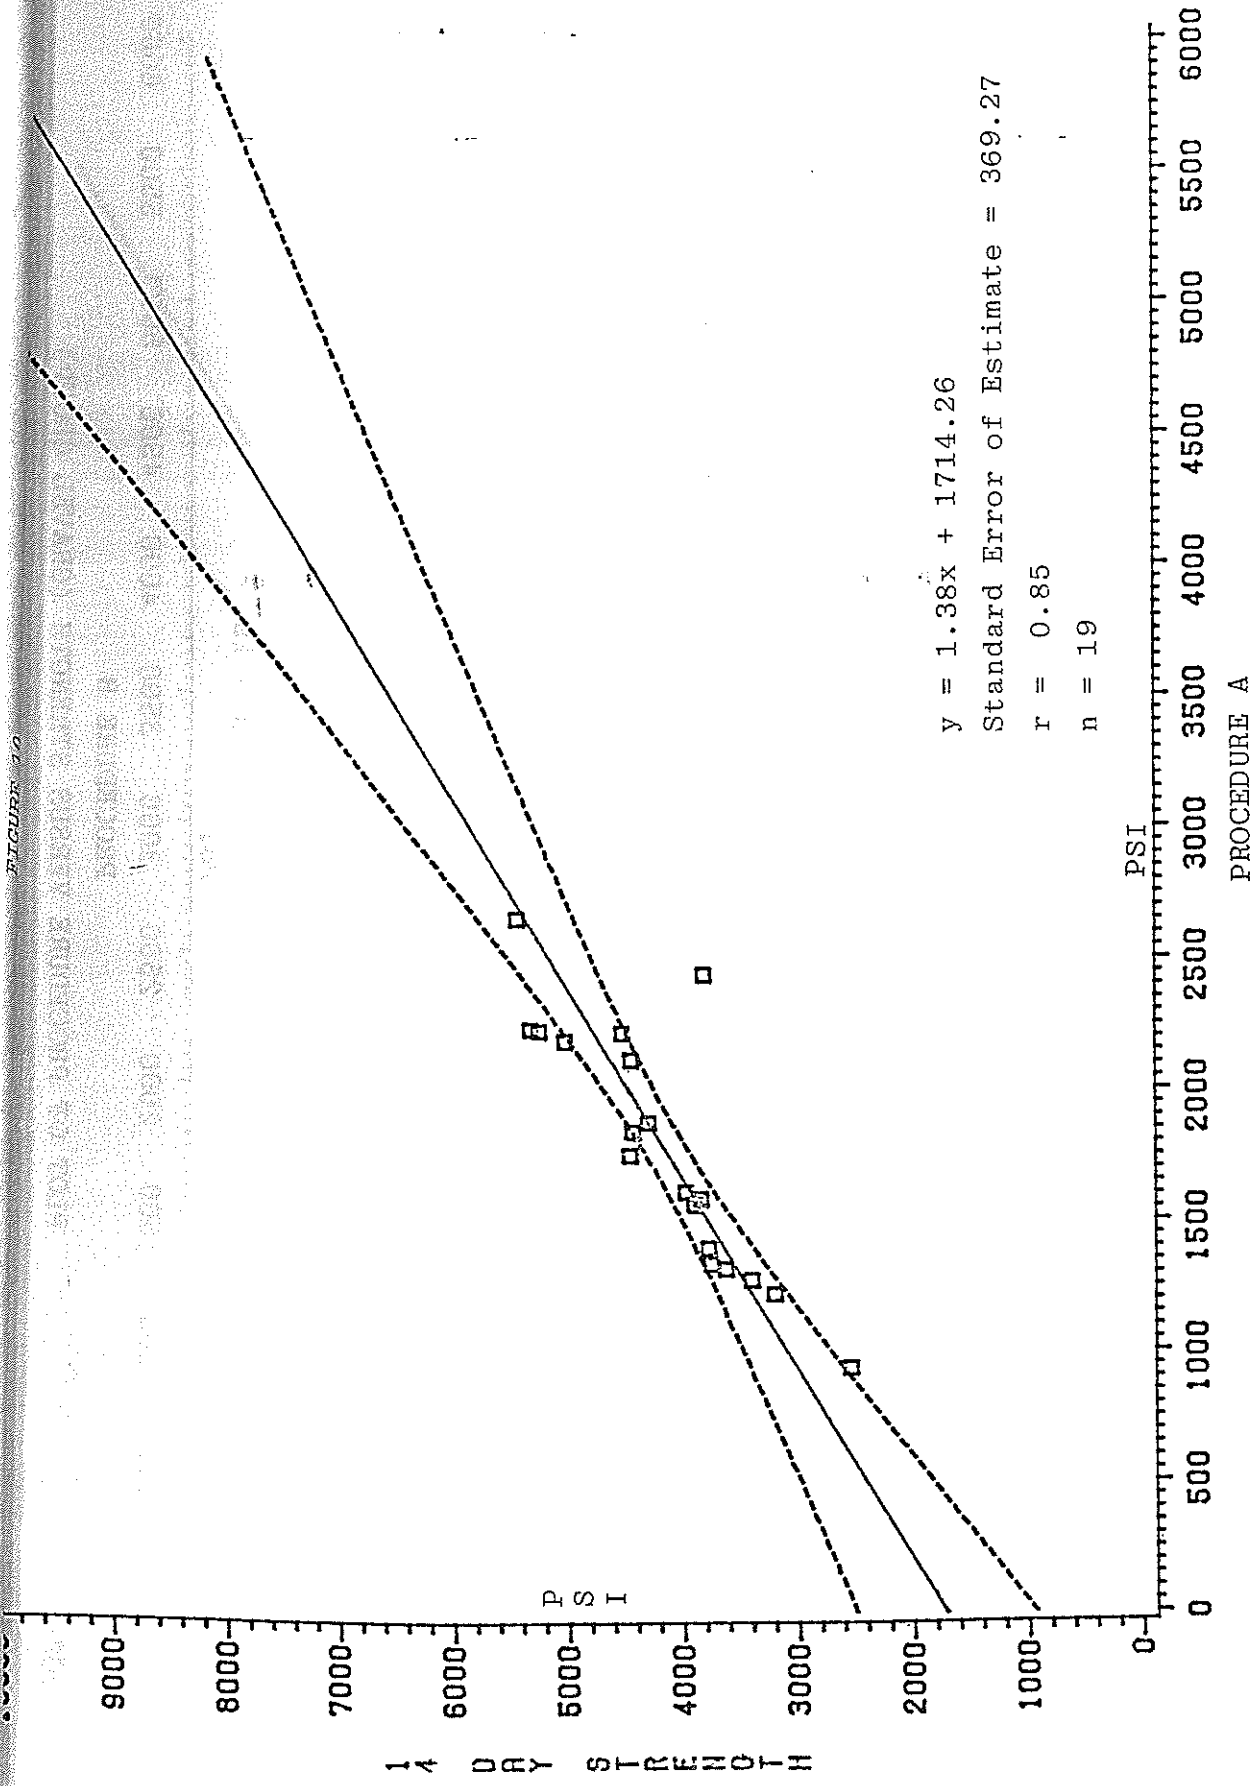



FIGURE 11
PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

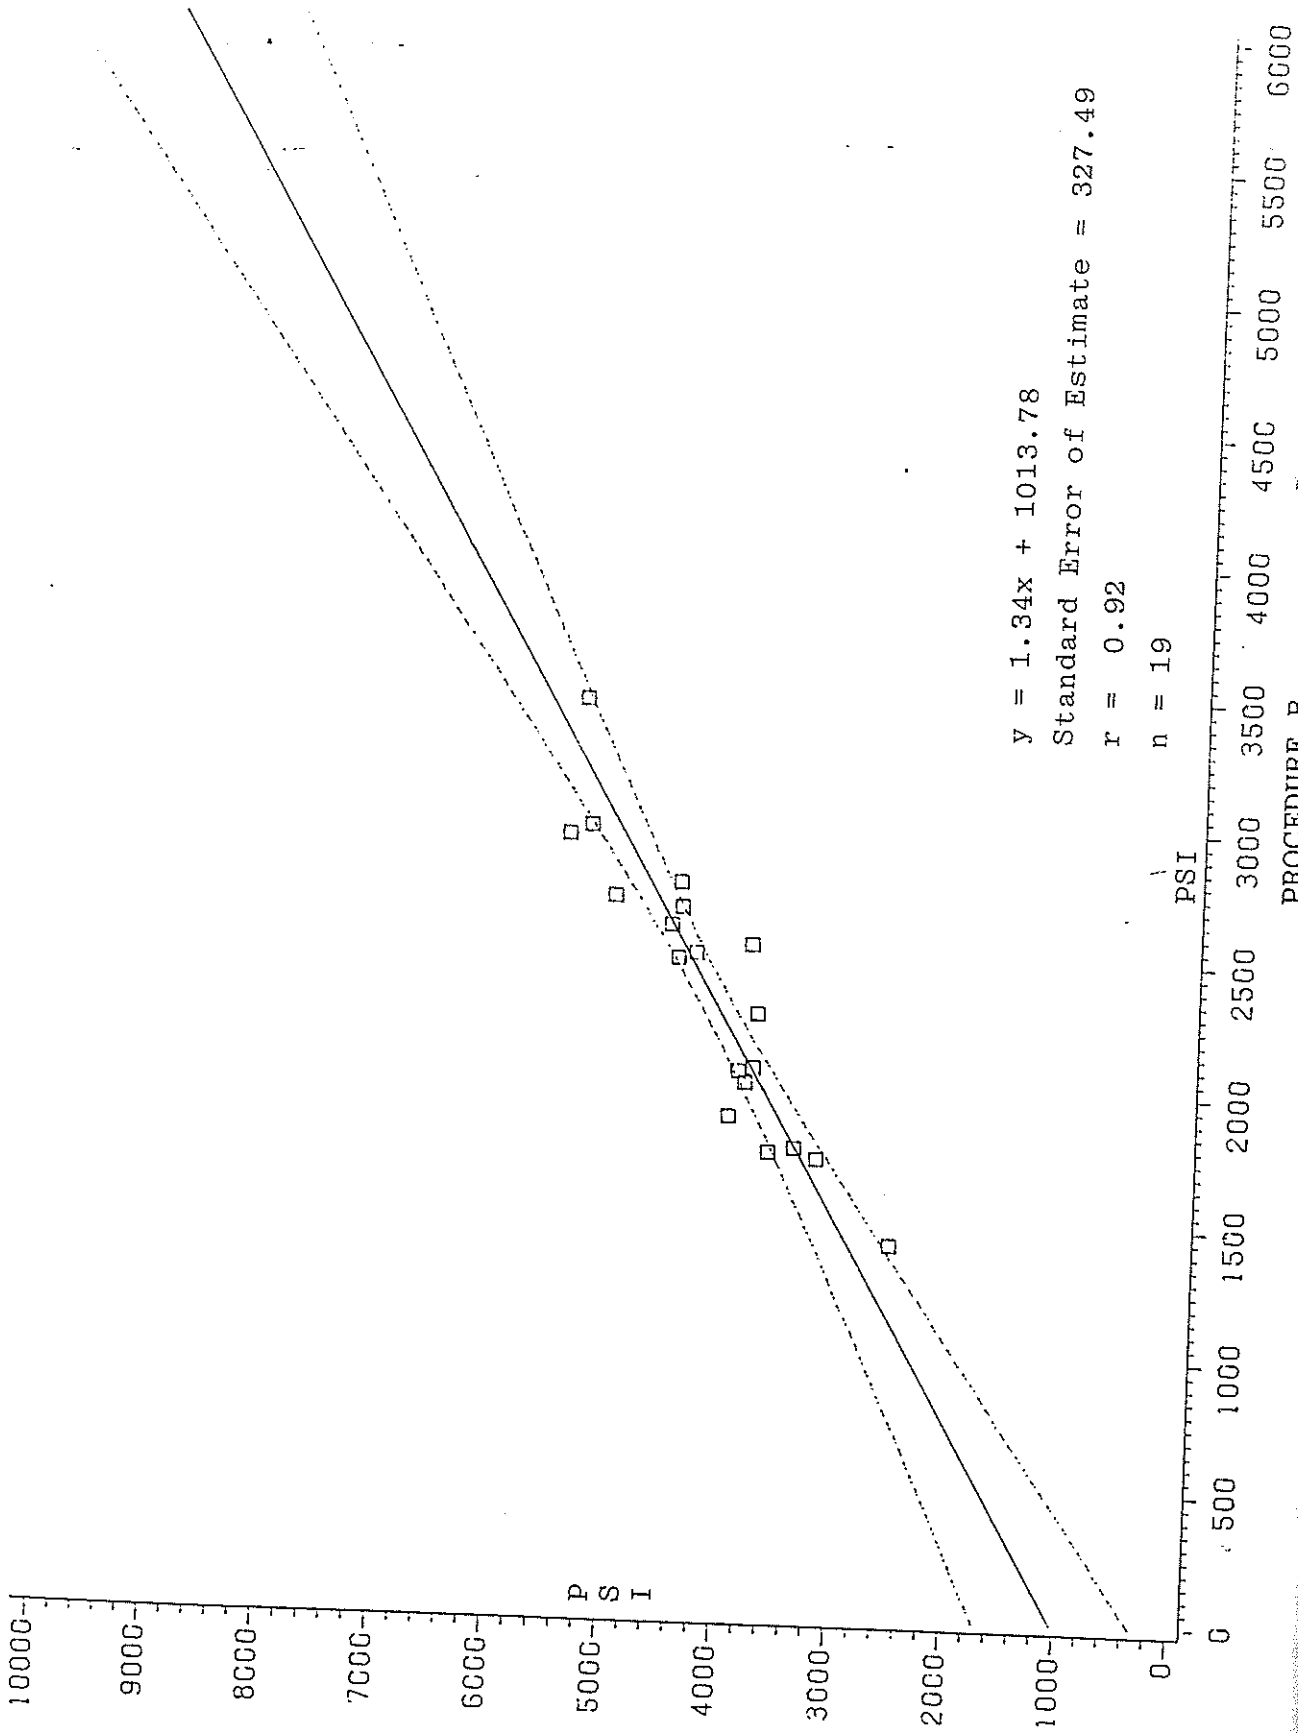

4 DAY STRENGTH


PSI
0 500 1000 1500 2000 2500 3000 3500 4000 4500 5000 5500 6000
PROCEDURE B

PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

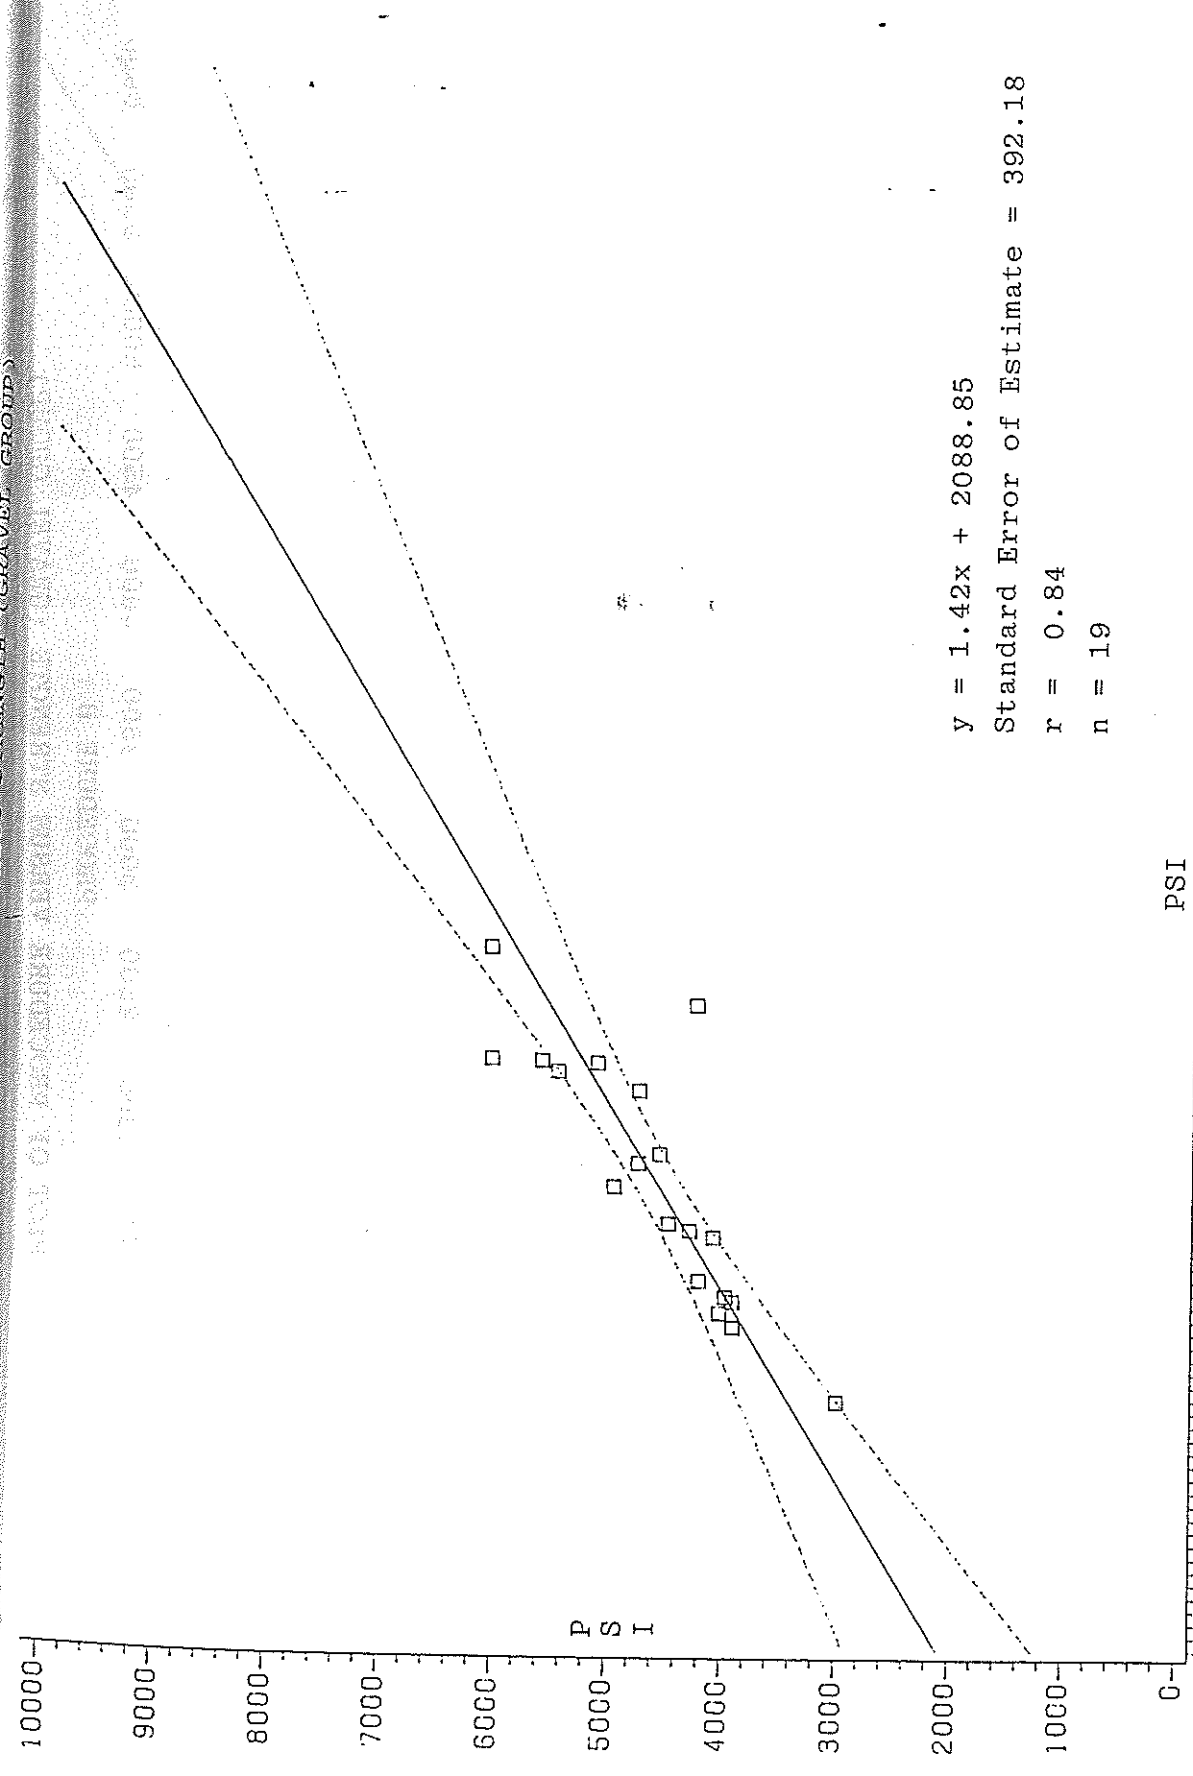


PSI
0 500 1000 1500 2000 2500 3000 3500 4000 4500 5000 5500 6000
PROCEDURE A

PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

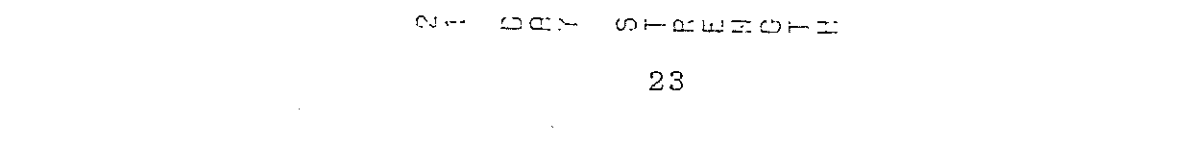


PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUP)

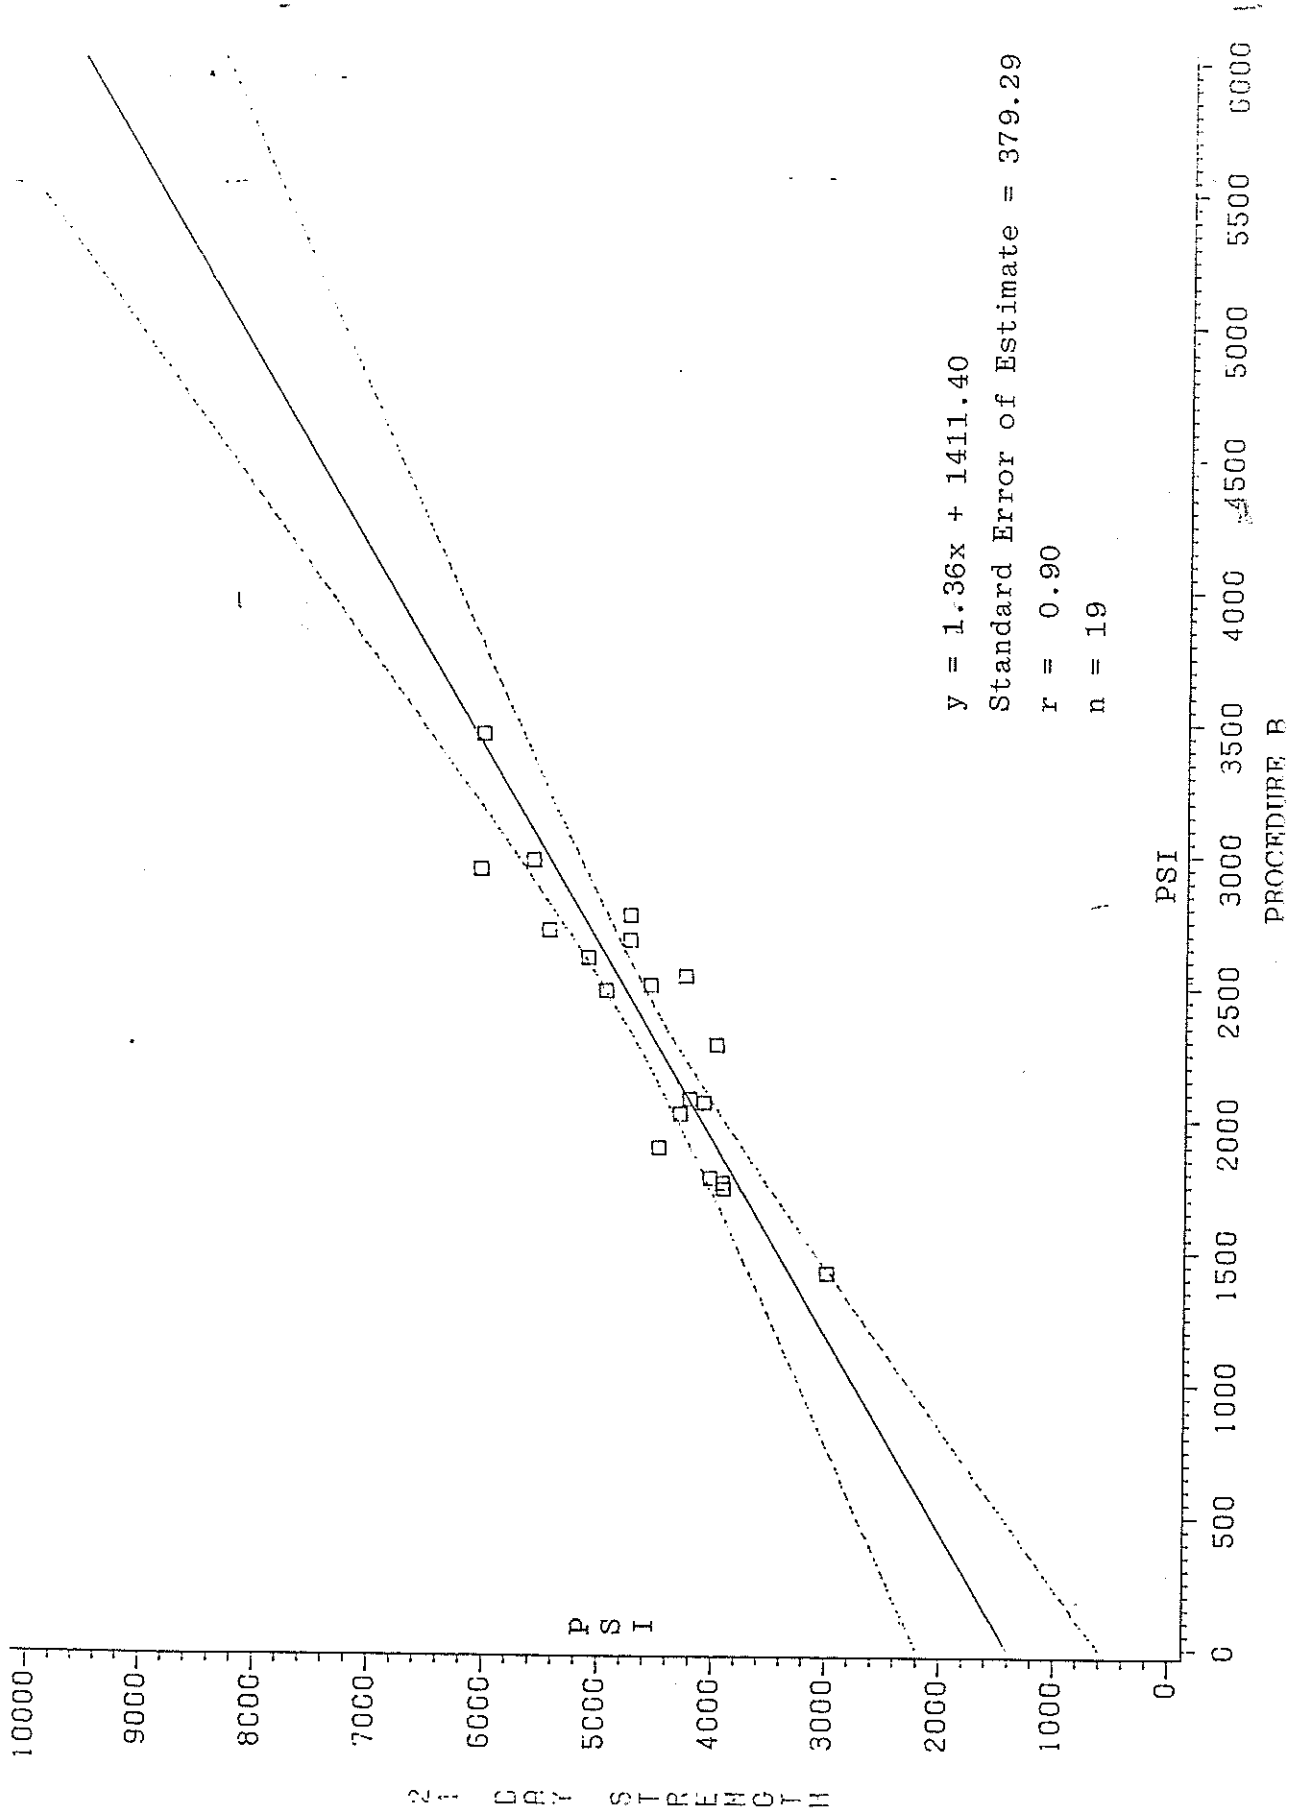


24 DRY STRENGTH

4000 2500 3000 3500 4000 4500 5000 5500 6000
 PROCEDURE B
 PLOT OF PROCEDURE VERSUS STRENGTH (GRAVEL GROUPS)

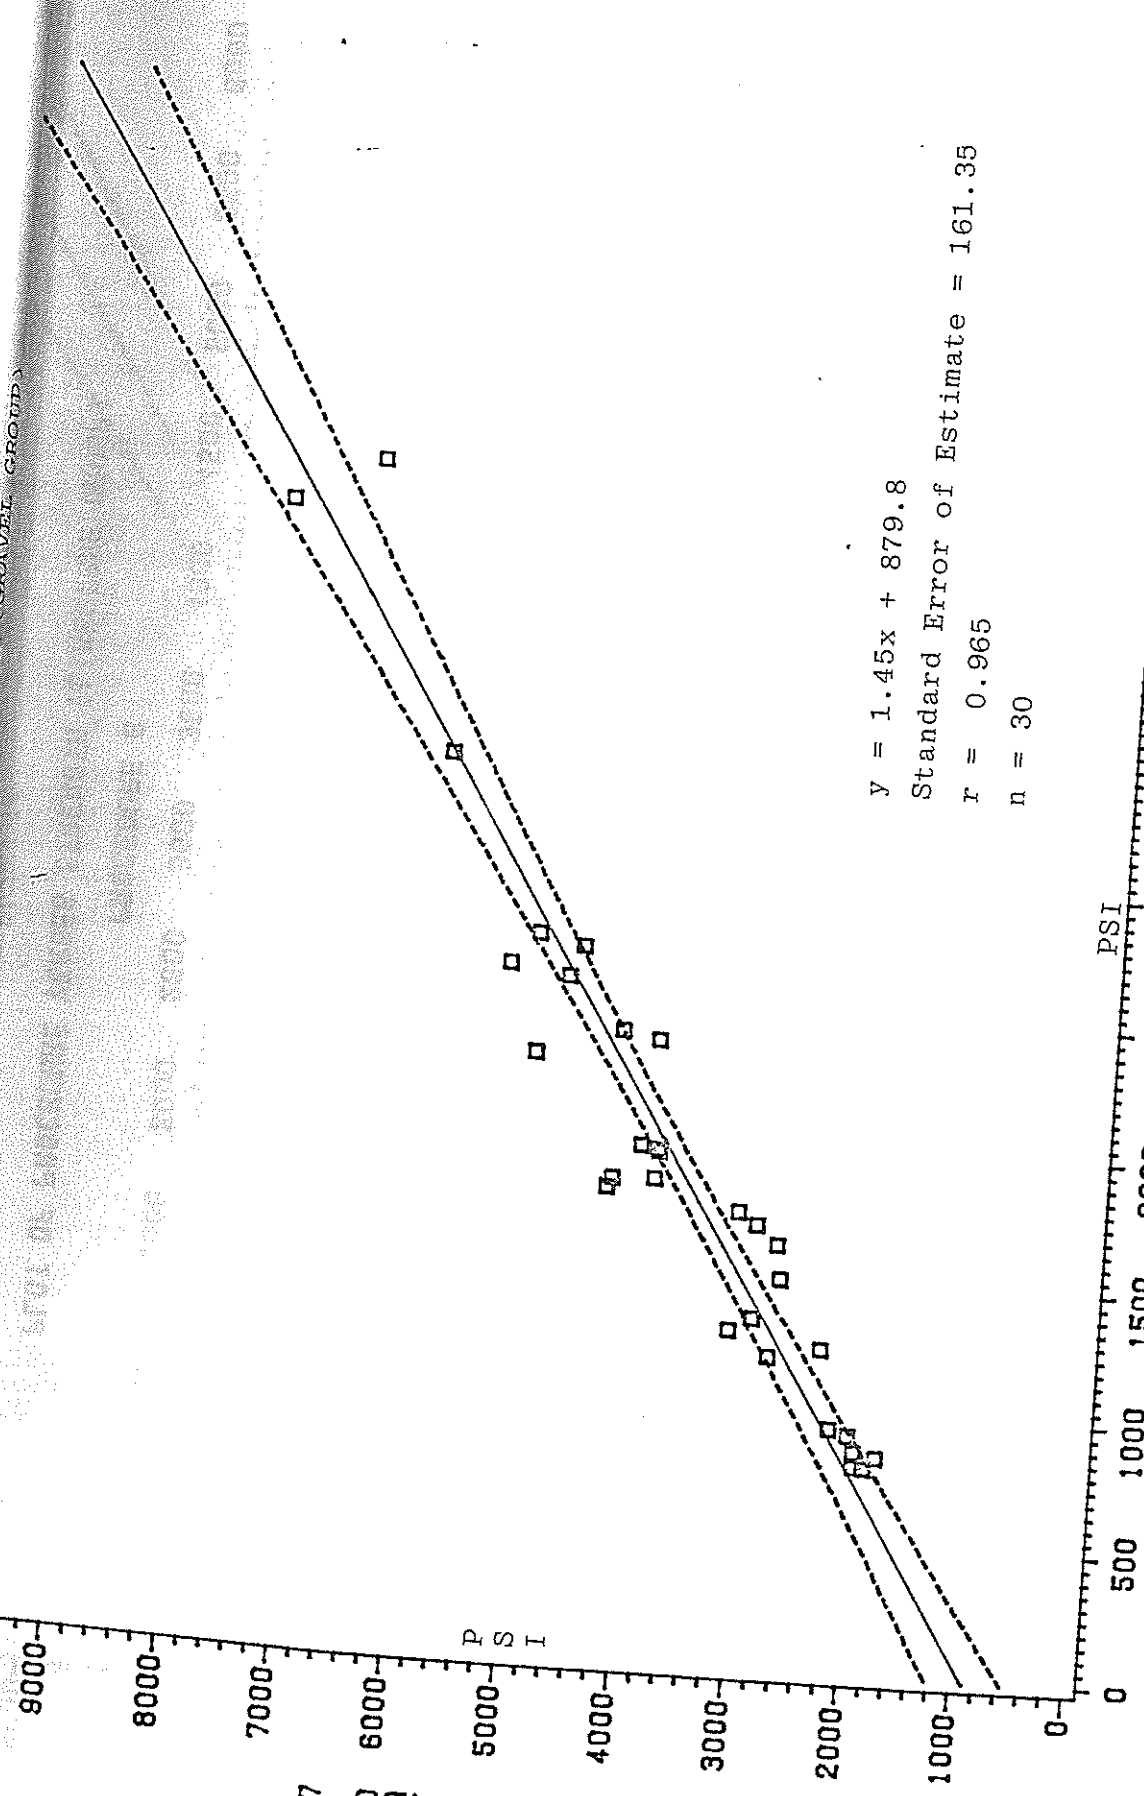

0 500 1000 1500 2000 2500 3000 3500 4000 4500 5000 5500 6000
 PSI
 PROCEDURE A
 PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)


FIGURE 15

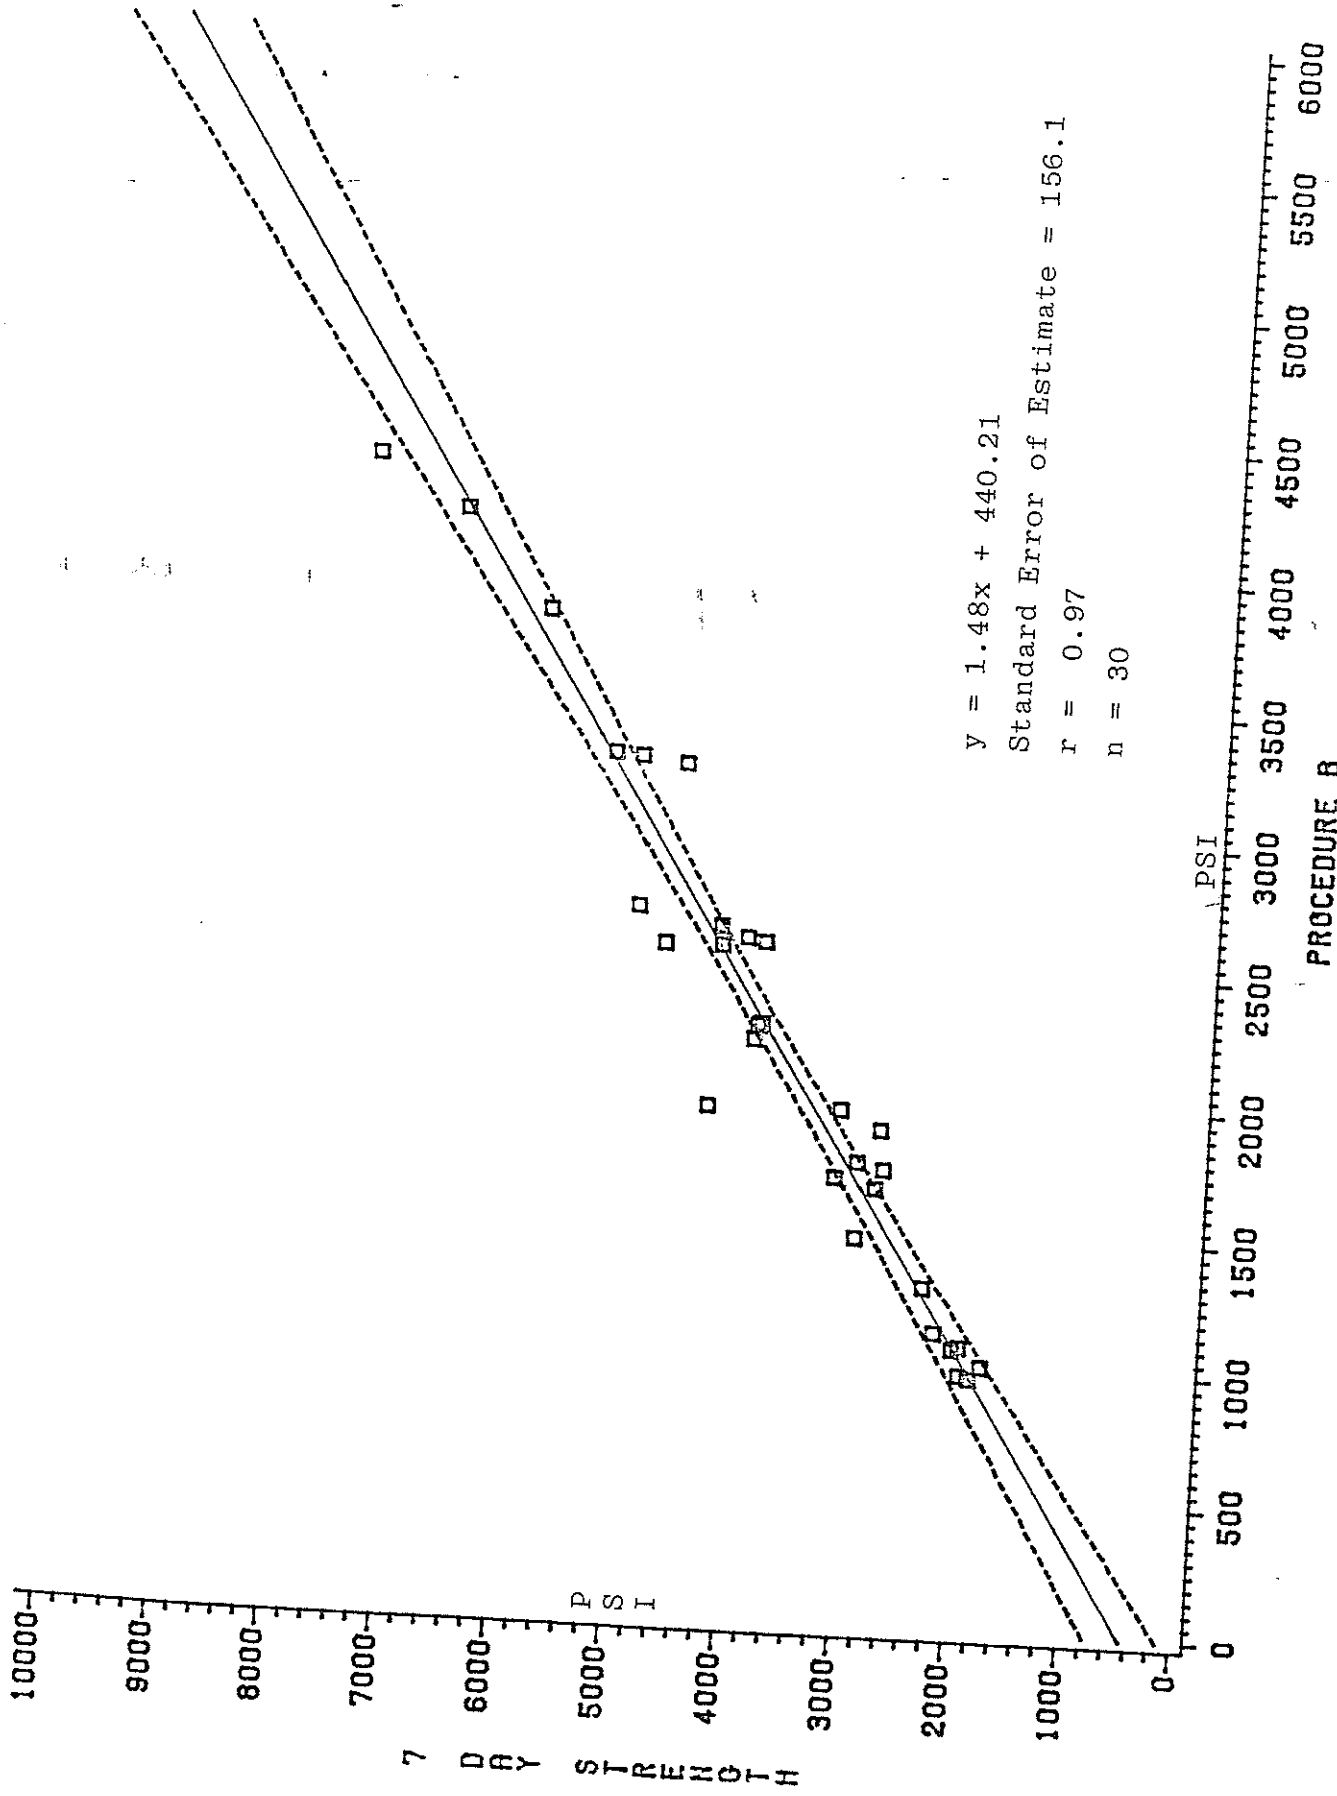

PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)
 PROCEDURE B

PROCEDURE B


PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)

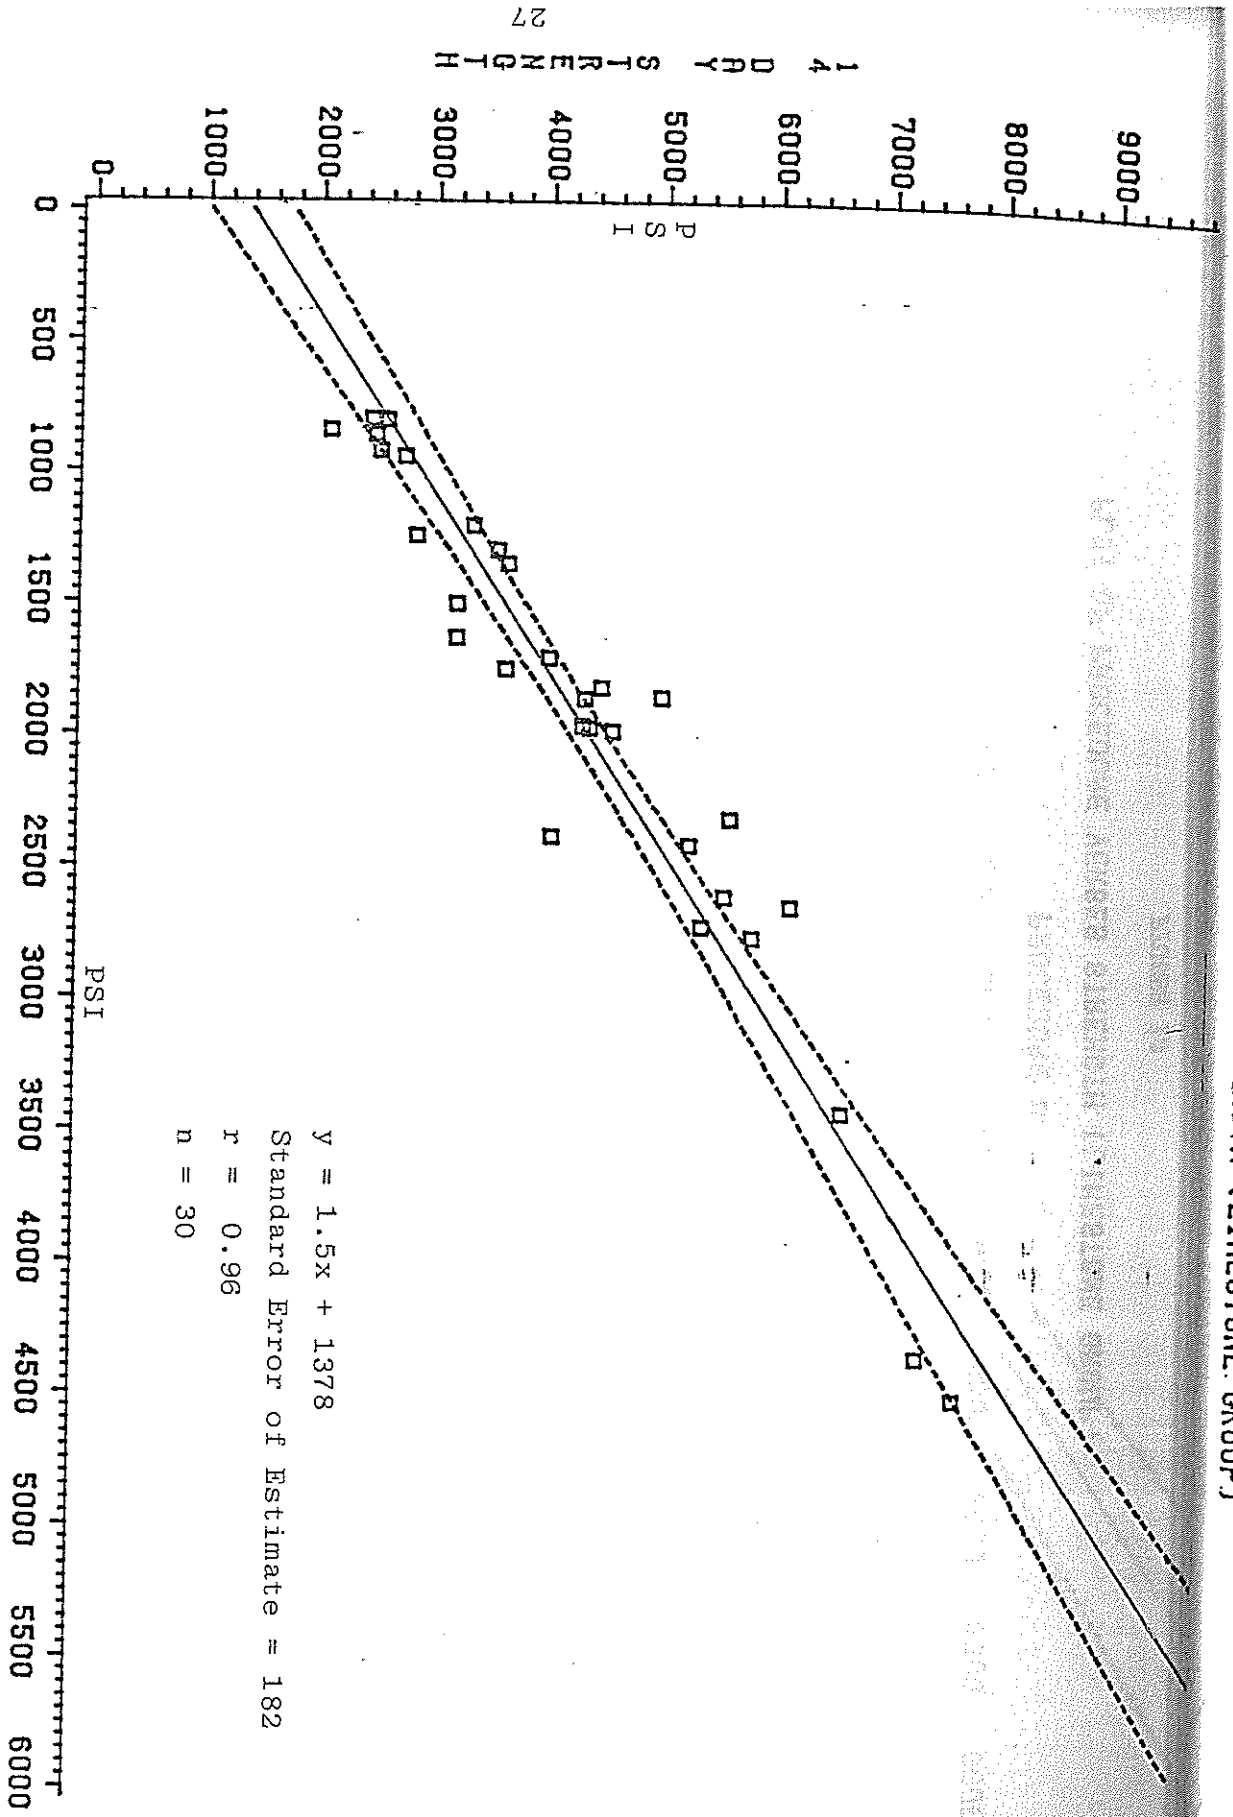


PROCEDURE A

PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)


FIGURE 17

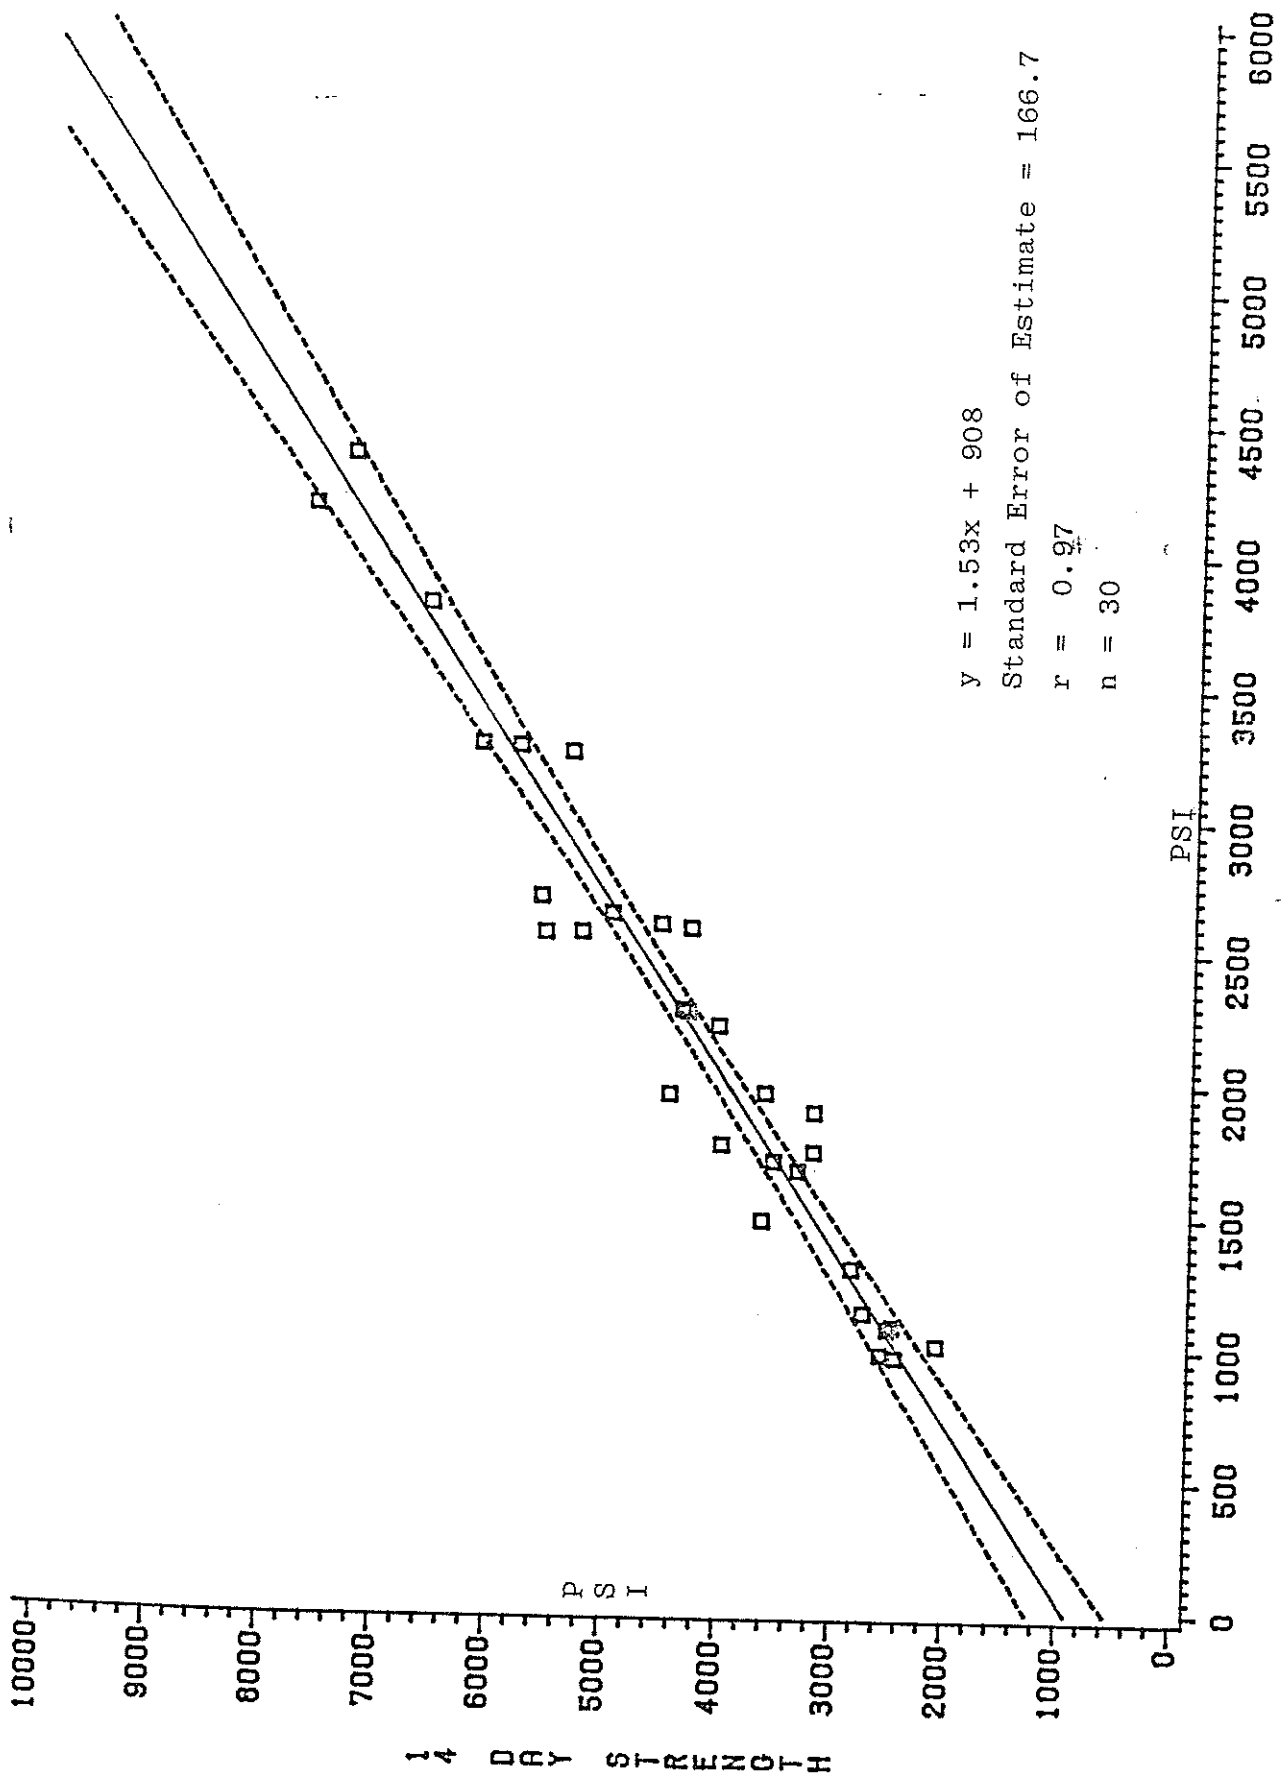


PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)
 PROCEDURE B

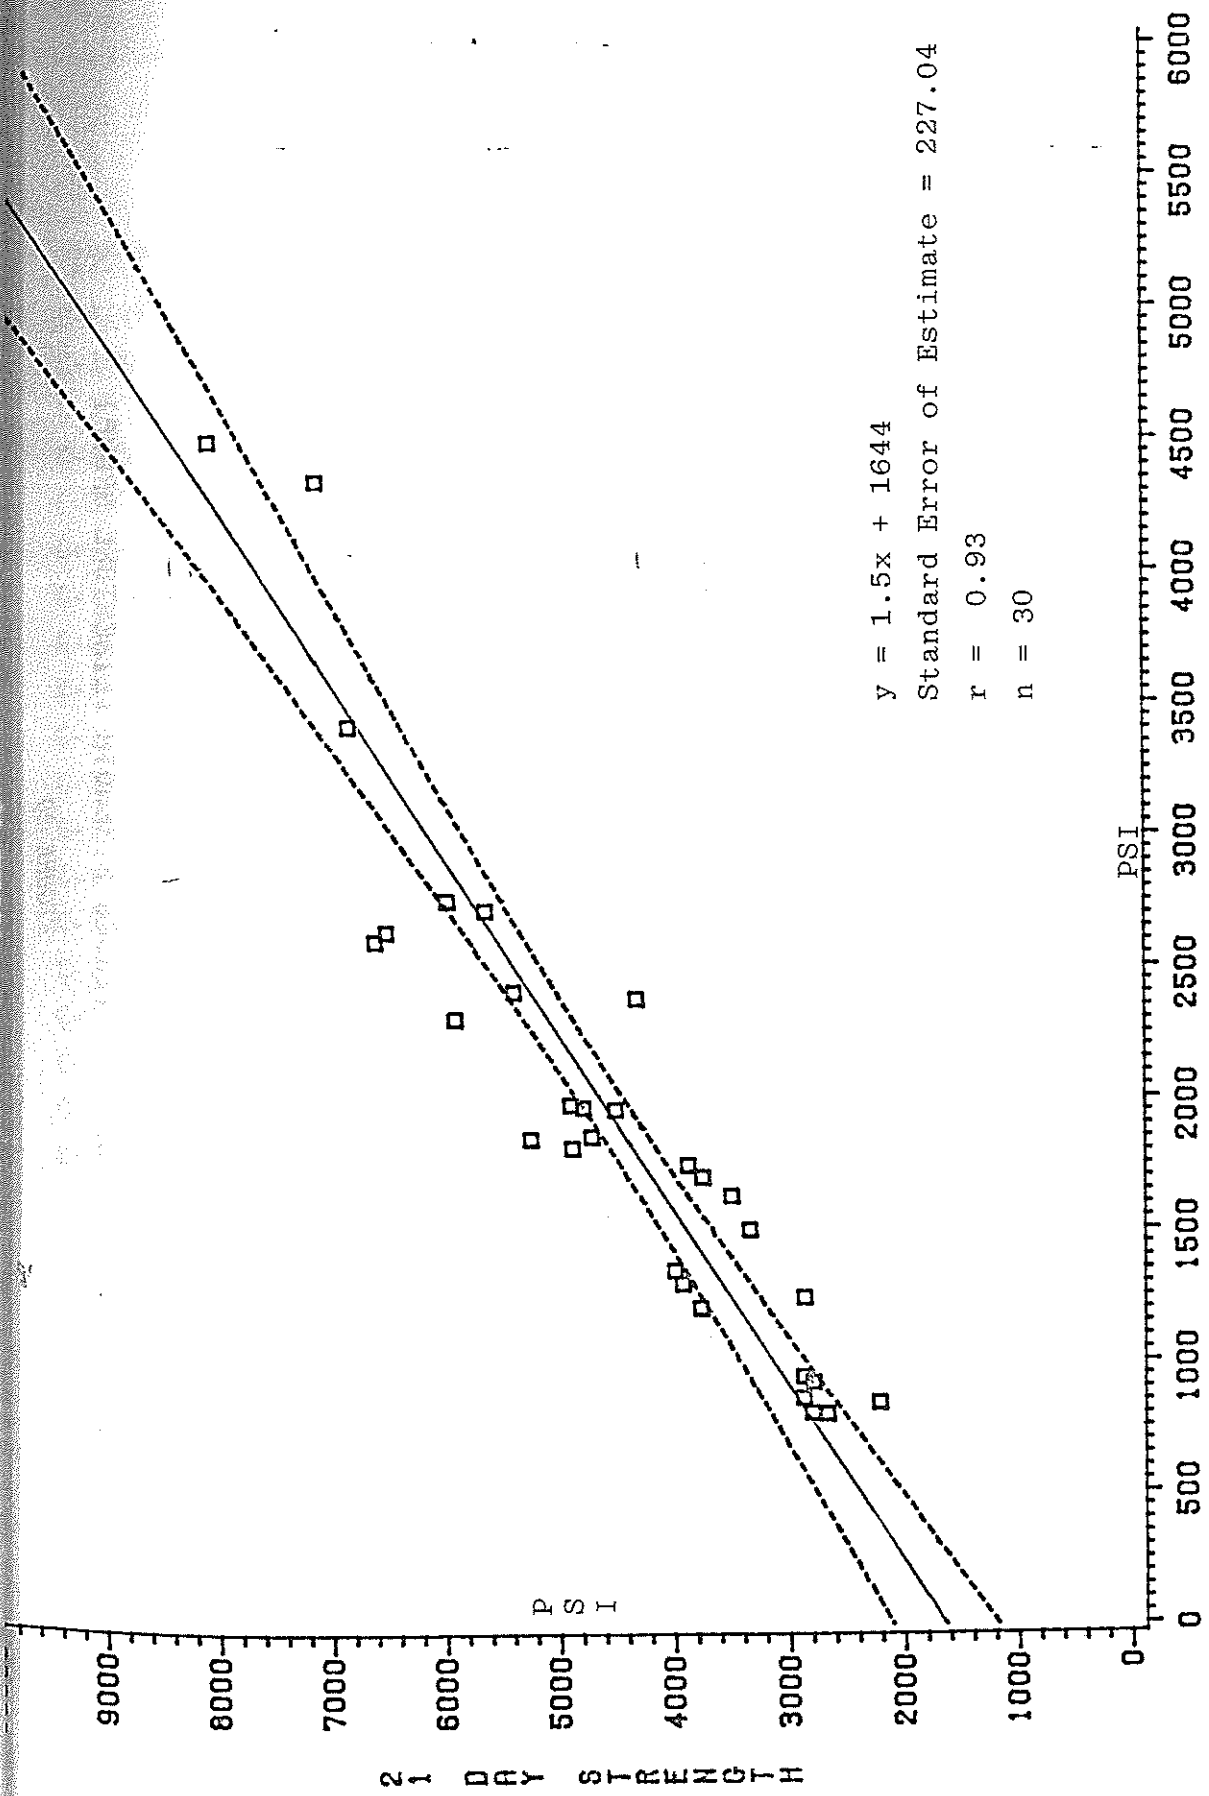

21 DAY STRENGTH



PROCEDURE A
PLOT OF PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)

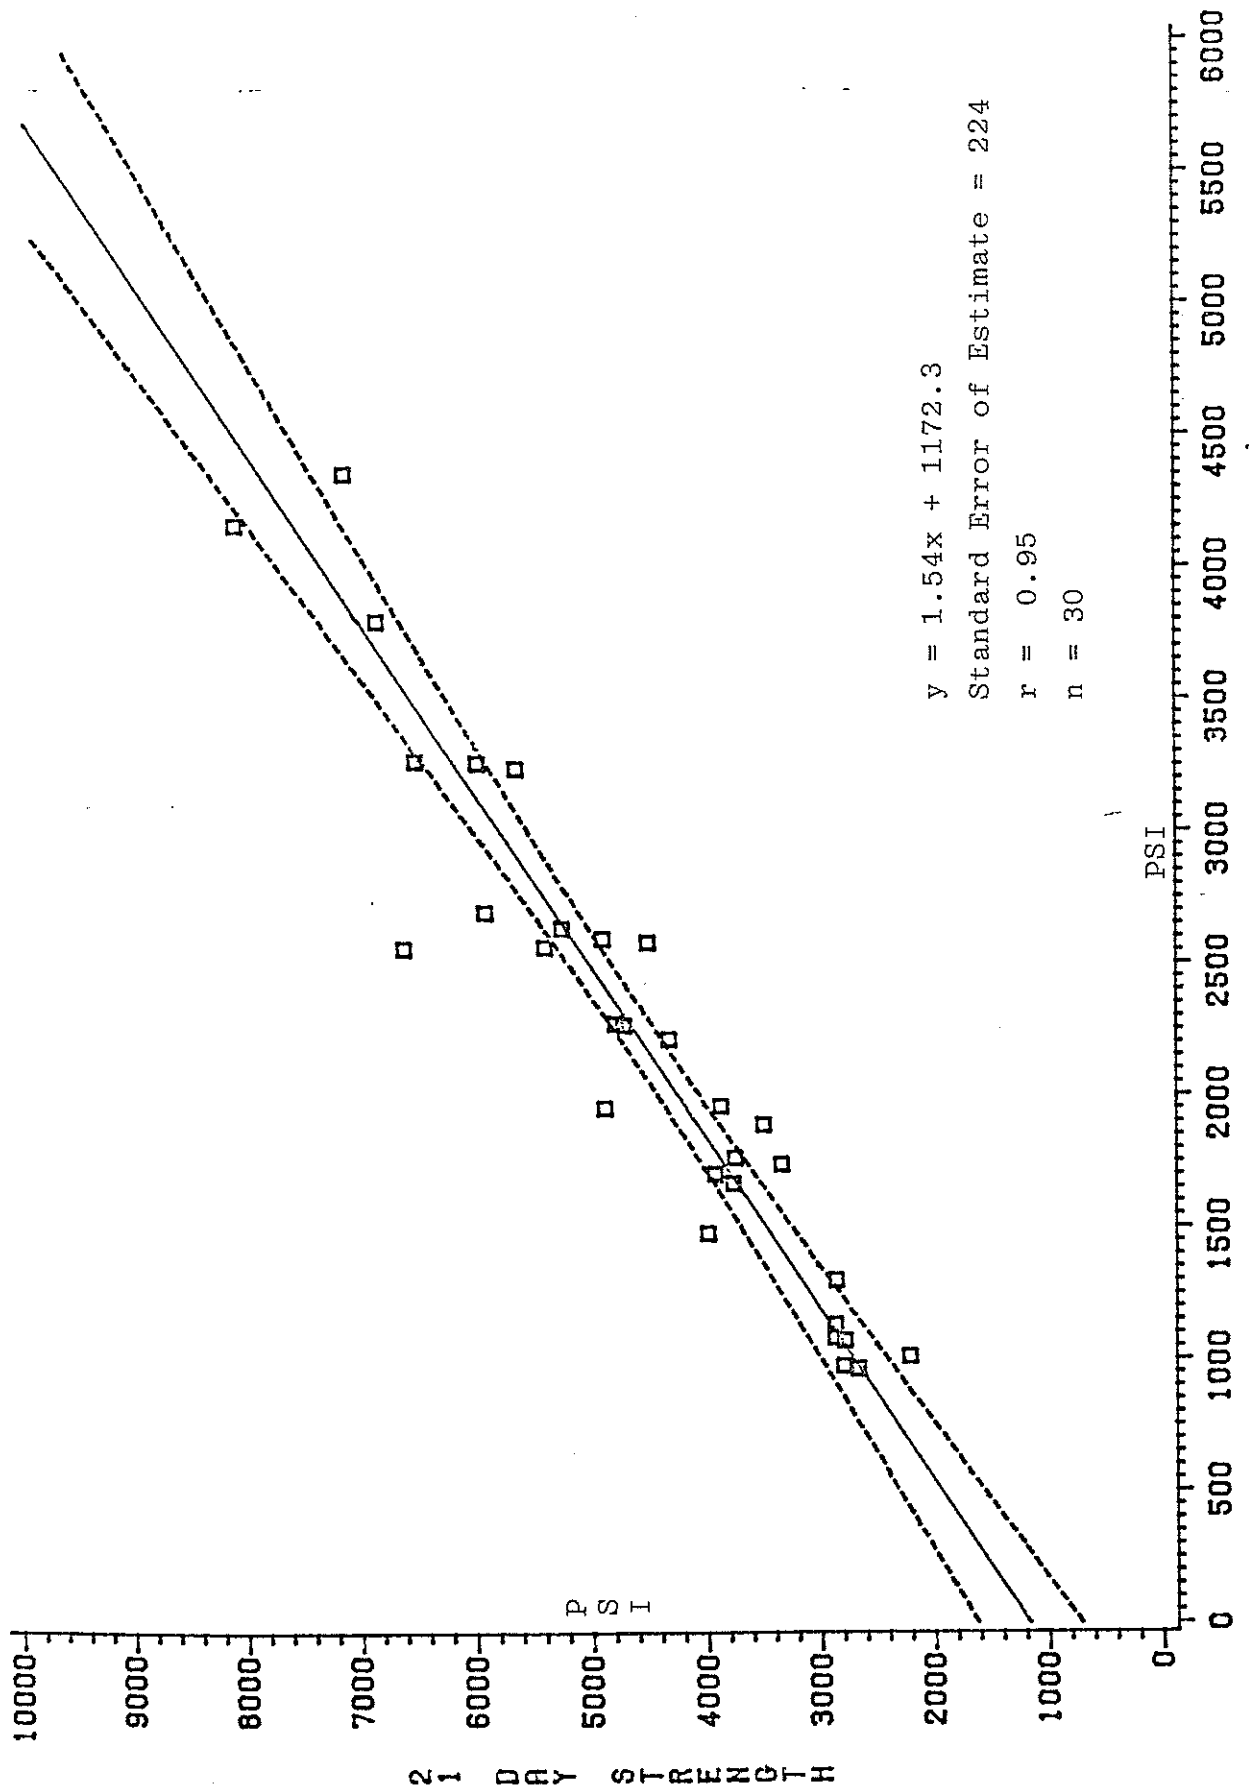

PROCEDURE VERSES STRENGTH (LIMESTONE GROUP)

TABLE 1
MIX DESIGN AND PLASTIC CONCRETE DATA
GRAVEL GROUP

| Lab No. | Cement Content | W/C Ratio | Admixture | Slump (In.) | Air Content (%) | Unit Weight (Lbs/ft ³) |
|-----------|----------------|-----------|----------------------|-------------|-----------------|------------------------------------|
| C-1041 | 5.0 | 0.40 | Water reducer | 1 | 2.7 | 146.8 |
| C-1045 | 5.0 | 0.40 | Air, water reducer | 3 | 6.4 | 139.2 |
| C-1050 | 5.0 | 0.50 | None | 1-3/4 | 2.0 | 144.8 |
| C-1068 | 5.0 | 0.60 | None | 6-1/2 | 1.0 | 144.8 |
| C-1069 | 5.0 | 0.54 | Air | 6-3/4 | 5.1 | 139.6 |
| C-1070 | 6.0 | 0.40 | Water reducer | 3 | 3.0 | 145.2 |
| C-1071 | 6.0 | 0.40 | Air | 2 | 4.0 | 143.2 |
| C-1072 | 6.0 | 0.50 | None | 7 | 1.0 | 145.2 |
| C-1073 | 6.0 | 0.50 | Air | 7-1/2 | 4.0 | 140.0 |
| C-1074 | 6.0 | 0.60 | None | 9-3/4 | 0.5 | 143.2 |
| C-1075 | 6.0 | 0.60 | Air | - | 2.8 | 140.0 |
| C-1076 | 6.0 | 0.44 | None | 2-3/4 | 1.7 | 146.4 |
| C-1079 | 6.0 | 0.44 | Air | 5 | 5.4 | 139.2 |
| C-1080 | 7.0 | 0.44 | None | 5-3/4 | 1.0 | 145.2 |
| C-1081 | 7.0 | 0.42 | None | 2-1/2 | 1.0 | 146.4 |
| C-1083 | 7.0 | 0.42 | Air | 6-1/2 | 5.0 | 140.0 |
| C-1083(A) | 7.0 | 0.38 | Air | 2-1/4 | 4.8 | 143.2 |
| C-1116 | 7.0 | 0.45 | None | 5 | 1.2 | 145.2 |
| C-1144 | 7.5 | 0.40 | None | 4-1/4 | 1.2 | 146.0 |
| C-1146 | 7.5 | 0.35 | None | 1/4 | 1.2 | 148.0 |
| C-1147 | 7.5 | 0.30 | Super water reducer | 7 | 1.0 | 150.8 |
| C-1148 | 7.5 | 0.36 | Air | 1/2 | 3.0 | 146.0 |
| C-1152 | 7.5 | 0.31 | Air & sup. wat. red. | 2 | 2.6 | 148.0 |
| C-1155 | 7.5 | 0.27 | Air & sup. wat. red. | 2 | 3.0 | 148.0 |
| C-1156 | 4.0 | 0.11 | | | | |
| C-1157 | Void | | | | | |
| C-1159 | 4.0 | 0.50 | Super water reducer | 3/4 | N.R. | 145.6 |
| C-1160 | 4.0 | 0.65 | None | 3 | N.R. | 144.8 |
| C-1163 | 4.0 | 0.58 | Air | 4-1/4 | 5.4 | 139.6 |
| C-1165 | 4.0 | 0.70 | None | 4-1/2 | 1.3 | 144.8 |
| C-1169 | 4.0 | 0.75 | None | 9 | 1.3 | 144.4 |

TABLE 2

LISTING OF COMPRESSIVE STRENGTHS IN PSI
(GRAVEL GROUP)

| LABORATORY NUMBER | CEMENT WATER RATIO | CEMENT BAGS OF CEMENT | PROCEDURE A | | | | | | | PROCEDURE B | | | | | | |
|-------------------|--------------------|-----------------------|----------------|----------------|-----------------|-----------------|-----------------|----------------|----------------|-----------------|-----------------|-----------------|----------------|----------------|-----------------|-----------------|
| | | | 3 DAY STRENGTH | 7 DAY STRENGTH | 14 DAY STRENGTH | 21 DAY STRENGTH | 28 DAY STRENGTH | 3 DAY STRENGTH | 7 DAY STRENGTH | 14 DAY STRENGTH | 21 DAY STRENGTH | 28 DAY STRENGTH | 3 DAY STRENGTH | 7 DAY STRENGTH | 14 DAY STRENGTH | 21 DAY STRENGTH |
| C-1041 | 0.40 | 5.0 | 2569 | 3656 | 4435 | 4751 | 5150 | 1840 | 2673 | | | | | | | |
| C-1045 | 0.40 | 5.0 | 1951 | 2960 | 3750 | 3980 | 4295 | 1335 | 2275 | | | | | | | |
| C-1050 | 0.50 | 5.0 | 2161 | 3134 | 3975 | 4481 | 4449 | 1609 | 1886 | | | | | | | |
| C-1055 | 0.50 | 5.0 | 2067 | 3230 | 3898 | 4095 | 4200 | 1561 | 2057 | | | | | | | |
| C-1068 | 0.60 | 5.0 | 1900 | 2758 | 3396 | 4030 | 4497 | 1275 | 1770 | | | | | | | |
| C-1069 | 0.54 | 5.0 | 2151 | 2666 | 3199 | 3916 | 3928 | 1221 | 1732 | | | | | | | |
| C-1070 | 0.40 | 6.0 | 3239 | 4865 | 5328 | 6040 | 5730 | 2231 | 3446 | | | | | | | |
| C-1071 | 0.40 | 6.0 | 2730 | 3885 | 4453 | 4746 | 4851 | 2114 | 2763 | | | | | | | |
| C-1072 | 0.50 | 6.0 | 2553 | 3746 | 4462 | 4956 | 4996 | 1749 | 2480 | | | | | | | |
| C-1073 | 0.50 | 6.0 | 2102 | 3108 | 3776 | 4213 | 4257 | 1396 | 2071 | | | | | | | |
| C-1116 | 0.45 | 7.0 | 2797 | 3557 | 4525 | 5119 | 5203 | 2217 | 2605 | | | | | | | |
| C-1083 | 0.38 | 7.0 | 2768 | 3619 | 3820 | 4259 | 4496 | 2441 | 2535 | | | | | | | |
| C-1083 | 0.42 | 7.0 | 2484 | 3794 | 4302 | 4567 | 4804 | 1874 | 2499 | | | | | | | |
| C-1081 | 0.42 | 7.0 | 3430 | 4913 | 5439 | 6060 | 6096 | 2652 | 2937 | | | | | | | |
| C-1080 | 0.44 | 7.0 | 3099 | 4263 | 5254 | 5597 | 6115 | 2224 | 2970 | | | | | | | |
| C-1079 | 0.44 | 6.0 | 2181 | 3403 | 3844 | 4301 | 4435 | 1585 | 2016 | | | | | | | |
| C-1076 | 0.44 | 6.0 | 2827 | 4021 | 5026 | 5455 | 5677 | 2187 | 2706 | | | | | | | |
| C-1075 | 0.60 | 6.0 | 1482 | 2364 | 2540 | 3000 | 3218 | 940 | 1413 | | | | | | | |
| C-1074 | 0.60 | 6.0 | 1678 | 2628 | 3629 | 3921 | 4227 | 1317 | 1753 | | | | | | | |
| C-1169 | | | | | | | | 518 | 773 | | | | | | | |
| C-1165 | 0.58 | 4.0 | | | | | | 757 | 925 | | | | | | | |
| C-1163 | 0.50 | 7.5 | | | | | | 833 | 1127 | | | | | | | |
| C-1159 | 0.65 | 4.0 | | | | | | 1247 | 2262 | | | | | | | |
| C-1160 | 0.27 | 7.5 | | | | | | 797 | 1140 | | | | | | | |
| C-1155 | 0.31 | 7.5 | | | | | | 5358 | 6567 | | | | | | | |
| C-1152 | 0.36 | 7.5 | | | | | | 4364 | 5463 | | | | | | | |
| C-1148 | 0.30 | 7.5 | | | | | | 3832 | 3782 | | | | | | | |
| C-1147 | 0.35 | 7.5 | | | | | | 4404 | 5711 | | | | | | | |
| C-1146 | 0.40 | 7.5 | | | | | | 4016 | 4506 | | | | | | | |
| C-1144 | | | | | | | | | | | | | | | | |

4908
2969

2509

4908

TABLE 3

MIX DESIGN AND PLASTIC CONCRETE DATA
LIMESTONE GROUP

| Lab No. | Cement Content | W/C Ratio | Admixture | Slump (In.) | Air Content (%) | Unit Weight (Lbs/ft ³) |
|---------|----------------|-----------|----------------------|-------------|-----------------|------------------------------------|
| C-1175 | 5.0 | 0.58 | None | 4-1/2 | 0.5 | 148.8 |
| C-1179 | 5.0 | 0.53 | Air agent | 4 | 5.0 | 144.4 |
| C-1180 | 5.0 | 0.50 | None | 3/4 | 0.6 | 149.2 |
| C-1181 | 5.0 | 0.45 | Air agent | 1 | 4.0 | 146.0 |
| C-1184 | 4.0 | 0.71 | Air agent | 2-1/2 | 1.5 | 148.8 |
| C-1187 | 4.0 | 0.64 | Air agent | 5 | 7.6 | 138.8 |
| C-1193 | 4.0 | 0.60 | Air agent | 1/4 | 0.8 | 150.4 |
| C-1197 | 4.0 | 0.54 | Air & sup. wat. red. | 1-3/4 | 5.7 | 146.4 |
| C-1207 | 6.0 | 0.53 | None | 6 | 0.5 | 148.4 |
| C-1218 | 6.0 | 0.46 | Air agent | 4-1/2 | 7.4 | 139.6 |
| C-1219 | 6.0 | 0.45 | None | 2 | 1.4 | 150.4 |
| C-1223 | 6.0 | 0.41 | Air agent | 2 | 4.8 | 145.2 |
| C-1231 | 7.0 | 0.53 | Air agent | 10 | 0.4 | 147.6 |
| C-1232 | 7.0 | 0.48 | Air agent | 10 | 4.6 | 142.4 |
| C-1233 | 7.0 | 0.44 | None | 3-3/4 | 1.4 | 150.8 |
| C-1235 | 7.0 | 0.40 | Air agent | 3-1/4 | 4.0 | 146.0 |
| C-1236 | 6.0 | 0.35 | Super water reducer | 1-1/2 | 2.3 | 154.0 |
| C-1237 | 7.0 | 0.39 | Super water reducer | 3-1/4 | 1.6 | 150.4 |
| C-1244 | 4.0 | 0.80 | None | 6 | 1.0 | 147.2 |
| C-1245 | 4.0 | 0.72 | Air agent | 8 | 4.0 | 143.6 |
| C-1246 | 4.0 | 0.71 | Air agent | 6 | 3.5 | 145.2 |
| C-1248 | 4.0 | 0.60 | Air agent | 1-3/4 | 3.8 | 146.8 |
| C-1255 | 4.0 | 0.65 | Air agent | 4 | 6.8 | 140.0 |
| C-1257 | 4.0 | 0.75 | None | 4 | 1.1 | 147.2 |
| C-1258 | 5.0 | 0.55 | None | 1-3/4 | 0.8 | 150.0 |
| C-1262 | 6.0 | 0.49 | None | 4 | 1.0 | 150.4 |
| C-1267 | 6.0 | 0.40 | None | 1 | 0.9 | 151.2 |
| C-1269 | 7.0 | 0.50 | None | 8-1/2 | 0.8 | 149.6 |
| C-1270 | 7.0 | 0.35 | Air agent | 4 | 7.0 | 140.8 |
| C-1273 | 6.0 | 0.35 | Air & sup. wat. red. | 1-1/2 | 4.0 | 149.2 |

TABLE 4

LISTING OF COMPRESSIVE STRENGTHS IN PSI
(LIMESTONE GROUP)

| LABORATORY NUMBER | CEMENT WATER RATIO | BAGS OF CEMENT | 7 DAY STRENGTH | 14 DAY STRENGTH | 21 DAY STRENGTH | 28 DAY STRENGTH | PROCEDURE A | PROCEDURE B |
|-------------------|--------------------|----------------|----------------|-----------------|-----------------|-----------------|-------------|-------------|
| 1175 | 0.58 | 5 | 3142 | 3552 | 3926 | 4274 | 1297 | 1704 |
| 1179 | 0.53 | 5 | 2780 | 3331 | 3763 | 3901 | 1202 | 1667 |
| 1180 | 0.50 | 5 | 4243 | 4991 | 5250 | 5401 | 1845 | 2637 |
| 1181 | 0.45 | 5 | 3844 | 4310 | 4508 | 4348 | 1958 | 2581 |
| 1184 | 0.71 | 4 | 2327 | 2845 | 2870 | 3277 | 1244 | 1300 |
| 1187 | 0.64 | 4 | 1784 | 2083 | 2216 | 2247 | 842 | 1009 |
| 1193 | 0.60 | 4 | 2759 | 3198 | 3503 | 3900 | 1627 | 1889 |
| 1197 | 0.54 | 4 | 3120 | 3637 | 3872 | 3968 | 1747 | 1961 |
| 1207 | 0.53 | 6 | 2947 | 4010 | 3754 | 4525 | 1701 | 1764 |
| 1218 | 0.46 | 6 | 2719 | 3197 | 3339 | 3569 | 1499 | 1739 |
| 1219 | 0.45 | 6 | 4225 | 5253 | 5396 | 5711 | 2406 | 2564 |
| 1223 | 0.41 | 6 | 3896 | 4048 | 4323 | 4503 | 2377 | 2213 |
| 1231 | 0.53 | 7 | 3841 | 4364 | 4794 | 5056 | 1966 | 2276 |
| 1232 | 0.48 | 7 | 3866 | 4323 | 4717 | 5014 | 1855 | 2269 |
| 1233 | 0.44 | 7 | 5008 | 5817 | 5983 | 6280 | 2754 | 3266 |
| 1235 | 0.40 | 7 | 4620 | 5365 | 5651 | 6178 | 2714 | 3242 |
| 1236 | 0.35 | 6 | 6646 | 7649 | 8092 | 9458 | 4510 | 4167 |
| 1237 | 0.39 | 7 | 5883 | 6627 | 6853 | 6879 | 3414 | 3799 |
| 1244 | 0.80 | 4 | 1977 | 2577 | 2803 | 2996 | 802 | 975 |
| 1245 | 0.72 | 4 | 1881 | 2445 | 2678 | 2946 | 801 | 964 |
| 1246 | 0.71 | 4 | 1985 | 2477 | 2877 | 3118 | 859 | 1081 |
| 1248 | 0.60 | 4 | 2939 | 3638 | 3993 | 4224 | 1346 | 1477 |
| 1255 | 0.65 | 4 | 2207 | 2733 | 2877 | 2993 | 943 | 1133 |
| 1257 | 0.75 | 4 | 2043 | 2520 | 2792 | 2974 | 922 | 1071 |
| 1258 | 0.55 | 5 | 4280 | 4468 | 4880 | 5150 | 1809 | 1952 |
| 1262 | 0.49 | 6 | 4721 | 5568 | 6614 | 6720 | 2599 | 2560 |
| 1267 | 0.40 | 6 | 5247 | 6153 | 6516 | 6586 | 2635 | 3273 |
| 1269 | 0.50 | 7 | 4979 | 5607 | 5919 | 6302 | 2302 | 2697 |
| 1270 | 0.35 | 7 | 4002 | 4567 | 4897 | 5097 | 1975 | 2595 |
| 1273 | 0.35 | 6 | 7444 | 7320 | 7132 | 8410 | 4346 | 4360 |

2697
2595
4360

2302
1975
4346

5097
8410

4897
7132

7320

7444

APPENDIX B

Use of Accelerated Strength Testing

Reported by ACI Committee 214

This report describes the three accelerated test methods given in ASTM C684 and gives guidance for the interpretation of the test results with the help of examples.

Keywords: coefficient of variation; compression tests; compressive strength; concrete construction; concretes; cylinders; evaluation; quality control; sampling; standard deviation; statistical analysis; variations.

Introduction

In concrete construction, the 28-day compressive test is usually used to evaluate the strength of concrete, although ACI 318 permits ages other than 28 days for acceptance purposes. Results of the 28-day tests determine if adjustments are required in the batching and mixing process to satisfy concrete quality parameters. With present methods of rapid construction it is imperative that methods be developed to estimate the 28-day strength of concrete cylinders at an earlier age.

ASTM Standard C684 specifies the following procedures to provide an early indication of the potential strength of concrete and the variability of the production process.²

Procedure A — Warm Water Method

Procedure B — Boiling Water Method

Procedure C — Autogenous Method

Procedures A and B permit testing of the cylinders at 24 and 28½ hr respectively, while Procedure C requires 49 hr (± 15 minutes) of curing before testing. Variations of these tests are used to con-

ACI Committee Reports, Guides, Standard Practices, and Commentaries are intended for guidance in designing, planning, executing, or inspecting construction, and in preparing specifications. Reference to these documents shall not be made in the Project Documents. If items found in these documents are desired to be part of the Project Documents, they should be phrased in mandatory language and incorporated into the Project Documents.

For discussion, see the October 1981 issue of *Concrete International: Design & Construction*. Copyright © 1981 American Concrete Institute. All rights reserved including rights of reproduction and use in any form or by any means including the making of copies by any photo process, or by any elec-

form with normal working hours. For example, one testing laboratory uses a 72 hr test for cylinders made at jobsites on Friday. This permits boiling, cooling, capping, and testing on Mondays.²

All three test procedures listed require equipment to control the temperature of the cylinders during the accelerated curing cycle. Fig. 1 and 2 show schematic drawings for two of the methods. After curing, the cylinders should be tested in accordance with ASTM procedures. When Procedure A is used, the cylinders are cured in a warm water bath at $95 \pm 5 \text{ F}$ ($35 \pm 3 \text{ C}$) for 23½ hr; ± 30 min. The warm water acts as an insulator and most of the acceleration in strength is provided by the heat of hydration. Procedure B requires an initial cure of 23 hr at $70 \pm 10 \text{ F}$ ($21 \pm 5 \text{ C}$) followed by immersion in boiling water for 3½ hr. A thermally insulated container is used with Procedure C. Cylinders are stored in this container for 48 hr, and the heat generated by hydration of the cement accelerates the strength gain. The most important use of accelerated test data is for quality control to permit rapid adjustment of batching and mixing. To estimate the 28-day strength from the accelerated strength test data, an equation must be established for the specific concrete mix using the same materials. This correlation is presently necessary because of the traditional use of the 28-day strength for design procedures. However, in the future as acceptance criteria change, it may be possible to work directly with accelerated strength tests.

Adequate lead time must be provided to establish basic correlation equations. Among factors that need to be considered are: project size, climatic conditions, properties of concrete mix and material, and physical facilities at a batching plant or jobsite. A minimum of 30 sets of test data covering a wide strength range are needed to establish an adequate correlation equation; for a single strength require-

tronic or mechanical device, printed or written or oral, or recording for sound or visual reproduction or for use in any knowledge or retrieval system or device, unless permission in writing is obtained from the copyright proprietors.

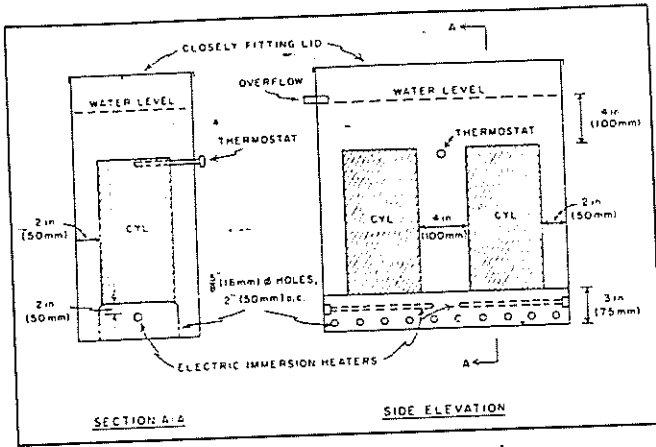


Fig. 1 - Accelerated curing water tank (Procedure A).

ment, the strength range should include the specified strength and should equal at least 75 percent of the specified strength. It should be achieved by the use of not fewer than three water-cement ratios. A correlation coefficient of less than 0.80 should be regarded with suspicion. Fig. 3 shows a typical correlation curve for cylinders tested by the boiling method.⁵ Similar curves can be developed for other methods.

Interpretation of test results

ACI 214, "Recommended Practice for Evaluation of Strength Test Results of Concrete," can be used in interpreting both standard and accelerated test results. The following formula and table of *t* values can be used for the application of statistical procedures to quality control of concrete:

$$f_{cr} = f_c' + t\sigma \tag{1}$$

where

f_{cr} = required average strength,

f_c' = design strength specified

t = a constant depending on the proportion of tests that may fall below f_c' . (Table 1)

σ = forecast value of the standard deviation.

The value of f_{cr} obtained from this equation can be either the usual 28-day strength or the actual accelerated strength, depending upon the corresponding value of f_c' .

The probability value, *t*, (Table 1) estimates the percentage of cylinders that do not achieve the mix proportion strength f_c' . For example, a value of *t* equal to 1.28 indicates that 10 percent of the cylinders will test lower than f_c' .

The standard deviation, σ , is based on the variability of test results. For concrete batch plants that have a capability of supplying a consistent strength in their product, the value of σ will be low. References 1, 3, and 4 present methods for computing the standard deviation.

Other statistical methods for comparing test data for different projects and the variation within tests are also presented in ACI 214.¹ However, the above formula is all that is needed to establish the target

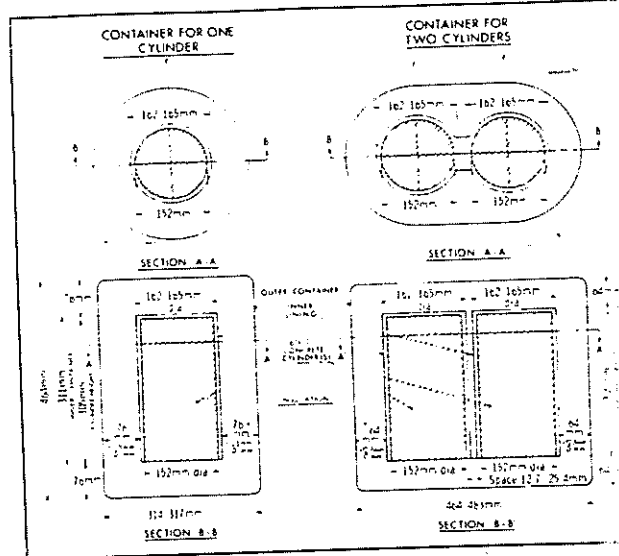


Fig. 2 - Autogenous curing container (Procedure C).

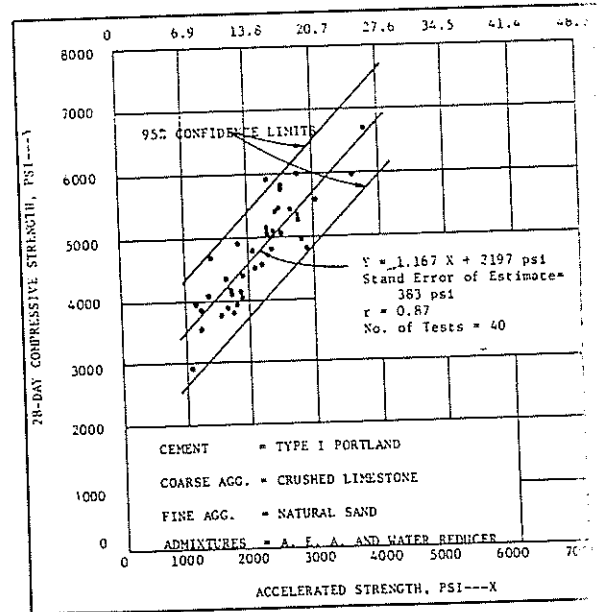


Fig. 3 - Relationship between accelerated day compressive strength of concrete. Data by the boiling method (Procedure B).

TABLE 1 - Values of *t* for the equation: $f_{cr} =$

| Number | Likelihood of low test results | |
|-----------|--------------------------------|--|
| | Percentage | |
| 1 in 1000 | 0.1 | |
| 1 in 500 | 0.2 | |
| 1 in 100 | 1.0 | |
| 1 in 50 | 2.0 | |
| 1 in 25 | 4.0 | |
| 1 in 20 | 5.0 | |
| 1 in 10 | 10.0 | |
| 1 in 5 | 20.0 | |
| 1 in 2 | 50.0 | |

TABLE 2 — Values of *t* for use in Eq. (2)

| <i>n</i> | <i>t</i> |
|----------|----------|
| 10 | 0.59 |
| 11 | 0.55 |
| 12 | 0.52 |
| 13 | 0.50 |
| 14 | 0.48 |
| 15 | 0.46 |
| 16 | 0.44 |
| 17 | 0.43 |
| 18 | 0.41 |
| 19 | 0.40 |
| 20 | 0.39 |
| 21 | 0.39 |
| 22 | 0.37 |
| 23 | 0.36 |
| 24 | 0.35 |
| 25 | 0.34 |
| 26 | 0.34 |
| 27 | 0.33 |
| 28 | 0.32 |
| 29 | 0.32 |
| 30 | 0.31 |

n = Number of pairs of test data used in establishing the correlation equation.
 Note: Table 2 is based on a one-sided confidence limit of 95 percent for points on the line.

average strength for a given project. The following two examples illustrate the use of the formula:

Example 1: Obtain the value for f_c , if contract specifications require the accelerated strength to be 1800 psi and that the *t* value is 1.28 (1 in 10, the acceptable number of low tests.) Past history of this producer shows that the accelerated strength test standard deviation is 500 psi.

$f_c = 1800 + 1.28(500) = 1800 + 640 = 2440$ psi.
 The concrete mix must be designed so that the average value of the accelerated compressive strength test is at least 2440 psi.

Example 2: If contract specifications require the 28-day strength to be 4000 psi, what must be the target average value of all cylinders for accelerated strength. Assume the following:

- (1) that the *t* value is 1.28 (1 in 10, the acceptable number of low tests).
- (2) the standard deviation for concrete of this producer for the particular accelerated strength test to be used is 525 psi, and
- (3) that the following relationship between the accelerated and the 28-day cylinder strength has been established for this producer.

$Y = 1.167X + 2197$ psi
 where *Y* = 28-day strength, and
X = accelerated strength.

$4000 = 1.167(X) + 2197$

Thus $X = 1545$ psi

And, $f_c = f'_c + t\sigma_c$
 $= 1545 + 1.28(525)$

$f_c = 2217$ psi.

The concrete mix proportion must result in an average value of the accelerated compressive strength of at least 2217 psi.

If fewer than 30 tests were used in establishing the correlation used in Example 2, then a more sophisticated statistical treatment is needed. An example is presented in the appendix assuming that the correlation curve was developed with 15 sets of test results.

Concluding remarks

Accelerated strength testing can provide a reliable tool for quality control and for estimating the later age strength of a given concrete mix.^{5,6,7} Elaborate equipment is not required for the tests discussed above. The test methods have sufficient flexibility so that testing can be accomplished during normal working hours.⁷

APPENDIX

Correlations based on fewer than 30 tests

One area of uncertainty which has been overlooked in the method given in the main report is the lack of knowledge of the exact position of the regression line. To follow normal statistical procedure the required average accelerated strength should be increased so that it is based on a position of the line that is so unfavorable that larger indicated increases would be required less than 5 percent of the time. When 30 sets of data are used, however, the position of the line is so well determined that for correlations typically encountered the computed increase is less than 70 psi (0.5 MPa). The impact of a correction of this small magnitude does not justify the work involved in its computation.

When the number of tests is reduced below 30, the effect of ignoring this correction becomes progressively more important. It is recommended that correlations never be based on fewer than 10 pairs of tests and that when fewer than 30 are available the results be corrected to the upper 95 percent confidence interval for the regression of accelerated strength on 28-day strength. The method is as follows:

First Step: f_c for 28-day strengths is obtained from Eq. (1) as above where the symbols have the same meaning as given in the previous text.

Second Step: Convert f_c to a corresponding accelerated strength, f'_c by use of the linear relationship developed according to the method described in Reference 8, pp. 5-31 to 5-34. In developing this relationship, 28-day strength is used as the independent variable and accelerated strength as the dependent variable.

Third Step: The average accelerated strength is obtained by adding a second increment to f'_c , according to the relationship

$f_{c,a} = f'_c + t'\sigma_{c,a}$ (2)

$f_{c,a}$ is the required average accelerated strength due to the statistical variation in the relationship between accelerated and 28-day strength.

$\sigma_{y,x}$ is the standard deviation of y values for a given x value, also called the standard error of estimate

t' is a constant multiplier for $\sigma_{y,x}$ that depends on the number of pairs of data, n , used in calculating the linear regression line. t' is obtained from Table 2.

Eq. (2) is based on the assumption that the average of the accelerated strengths used in the relationship is close to f_{cr} . This assumption is met well enough if the data from which the relationship is calculated are obtained from concretes made with the same materials and mix proportions and under the same conditions that will exist in the project. The following example is similar to Example 2, but the correlation curve used in Example 3 was developed from 15 sets of data and uses the 28-day strength as the independent variable.

Example 3: If the contract specifications require the 28-day strength to be 4000 psi, what must be the target average value of all cylinders for accelerated strength? Assume the following:

1. The t value is 1.28 (1 low test in 10) for 28-day strengths.

2. The standard deviation for the concrete of this producer for 28-day cylinders is 525 psi.

3. The following relationship between accelerated cylinder strength and 28-day cylinders has been established for this producer:

$$Y = 0.7610 X - 1332 \text{ psi}$$

where Y = accelerated strength, and

X = 28-day strength.

This relationship was obtained from 15 pairs of results, and $\sigma_{y,x}$ for this relationship is 225 psi.

Using Eq. (1) $f_{cr} = f'_c + t\sigma_{y,x}$

$$f_{cr} = 4000 + 1.28(525) \\ = 4672 \text{ psi}$$

The corresponding accelerated strength is found from the correlation equation,

$$Y = 0.7610X - 1332 \text{ psi} \\ = 0.7610(4672) - 1332 \\ = 2223 \text{ psi}$$

Finally the average accelerated strength is found from Eq. (2)

$$f_{cr} = f'_c + t' \times \sigma_{y,x}$$

$$f_{cr} = 2223 + 0.46(225) \text{ (where } t' = 0.46 \text{ from Table 2)} \\ = 2327 \text{ psi.}$$

The concrete-mix must be designed so that the average accelerated strength is at least 2327 psi.

References

1. ACI Committee 214, "Recommended Practice for Evaluation of Strength Test Results of Concrete (ACI 214-77)," American Concrete Institute, Detroit, 1977, 14 pp.
2. "Standard Method of Making, Accelerated Curing, and Testing of Concrete Compression Test Specimens," (ANSI/ASTM C684-74(1979)), 1979 Annual Book of ASTM Standards, Part 14, American Society for Testing and Materials, Philadelphia, 1979, pp. 417-424.
3. *Realism in the Application of ACI Standard 214-65*, SP-37, American Concrete Institute, Detroit, 1973, 215 pp.
4. Cordon, William A., "Concrete Quality," *Enchiridion* E704-4, American Concrete Institute, Detroit, 1973, 26 pp.
5. Malhotra, V. M., "Canadian Experience in the Use of the Modified Boiling Method," *Transportation Research Record* No. 558, Transportation Research Board, Washington, D.C., 1975, pp. 13-18.
6. Smith, P., and Tiede, H., "Earlier Determination of Concrete Strength Potential," *Transportation Research Record* No. 210, Transportation Research Board, Washington, D.C., 1967, pp. 29-61.
7. Naik, T. R., "Practical Utilization of Accelerated Strength Testing Methods," University of Wisconsin, Milwaukee, Oct. 1975.
8. Natrella, M. G., "Experimental Statistics," *Handbook* No. 91, National Bureau of Standards, Washington, D.C., 1963, pp. 1-4 to 1-6.
9. *Accelerated Strength Testing*, SP-56, American Concrete Institute, Detroit, 1978, 319 pp.

This report was submitted to letter ballot of the committee which consists of 24 members: 17 were affirmative, 2 abstained, and 5 ballots were not returned. It has been processed in accordance with the Institute procedure and is approved for publication and discussion.

ACI Committee 214

Use of Accelerated Strength Testing

V. M. Malhotra
Chairman

R. M. Barnoff*
Subcommittee Chairman

Edward A. Abdun-Nur*
Howard T. Arni
John A. Bickley
Herbert K. Cook
Donald E. Dixon
Richard J. Doermann
Richard D. Gaynor

Steven H. Gebler
Gilbert Haddad
Arnold R. Kline
J. Hode Keyser
Peter A. Kopec
K. R. Lauer
H. S. Lew
Tarun R. Naik*

R. B. Pepler
Robert E. Philleo*
Doran S. Platt, Jr.
Francis J. Principe
V. Ramakrishnan
James P. Schwartz, Jr.
J. Derle Thorpe

*Members of the subcommittee which prepared this report.

is found
0.46 from
at the av-
osi.
tice for
ACI 214-
14 pp.
Curing,
imens,"
of ASTM
and Ma-
214-65,
215 pp.
iridion
26 pp.
Use of
search
shing-
ion of
search
shing-
erated
. Mil-
tbook
D.C.,
Con-
nsists
of re-
edure

ADDENDUM

An attempt was made to establish a direct correlation between the cement content, the amount of water used and the 28-day strength of concrete using the data from the mixes that were produced in this study and also similar mixes from other research projects. All of the mixes that were used to plot this graph were chosen from the mixes that had the same aggregate and cement type. No admixtures were used in these mixes.

In order to relate the 28-day strength to cement and water content, an arbitrary factor, which is referred to here as mix factor, was chosen. Mix factor is the cement factor (number of bags only such as 6.5, 7.0, etc.) divided by the water cement ratio (such as 0.4, 0.45, etc.). There is no unit for mix factor due to simplicity of plotting the curve. A mix containing 6.5 bags of concrete per cubic yard and a water cement ratio of 0.4 has a mix factor of $\frac{6.5}{0.4} = 16.25$.

Using the linear regression method, the equation of the best fit curve for the points (28-day strength versus mix factor) was calculated and the curve was plotted. According to this curve, as the water cement ratio increases or decreases the mix factor accordingly decreases or increases and so does the strength.

This was done to indicate that such a relationship could be established if there are statistically valid points, so a confidence level could be gained in using such a graph for directly estimating the 28-day strength for the same mixes under similar casting and curing procedures.


TABLE 5

MIX FACTOR DATA

28-DAY COMPRESSIVE STRENGTH FROM MIX FACTOR
(NO AIR, GRAVEL)

| <u>C.F.</u> | <u>W/C</u> | <u>Mix Factor</u> | <u>C.F.</u> <u>W/C</u> | <u>PSI</u> |
|-------------|------------|-------------------|---------------------------|------------|
| 4.0 | 0.70 | 5.7 | | 2921 |
| 4.0 | 0.75 | 5.3 | | 2181 |
| 4.0 | 0.65 | 6.2 | | 3273 |
| 4.0 | 0.67 | 6.0 | | 2661 |
| 5.0 | 0.59 | 8.5 | | 4081 |
| 5.0 | 0.50 | 10.0 | | 4449 |
| 5.0 | 0.60 | 8.3 | | 4497 |
| 5.5 | 0.51 | 10.8 | | 4761 |
| 5.8 | 0.49 | 11.8 | | 4551 |
| 6.0 | 0.48 | 12.5 | | 4770 |
| 6.0 | 0.60 | 10.0 | | 4227 |
| 6.0 | 0.44 | 13.6 | | 5677 |
| 6.0 | 0.48 | 12.5 | | 4329 |
| 6.5 | 0.43 | 15.1 | | 5159 |
| 6.5 | 0.44 | 14.8 | | 5171 |
| 7.0 | 0.44 | 15.9 | | 5200 |
| 7.0 | 0.42 | 16.7 | | 5259 |
| 7.0 | 0.42 | 16.7 | | 6096 |
| 7.0 | 0.45 | 15.5 | | 5203 |
| 7.5 | 0.40 | 18.75 | | 4908 |
| 7.5 | 0.35 | 21.4 | | 6455 |
| 6.0 | 0.50 | 12.0 | | 4257 |
| 7.0 | 0.44 | 15.9 | | 6115 |

COMPRESSIVE STRENGTH ESTIMATE

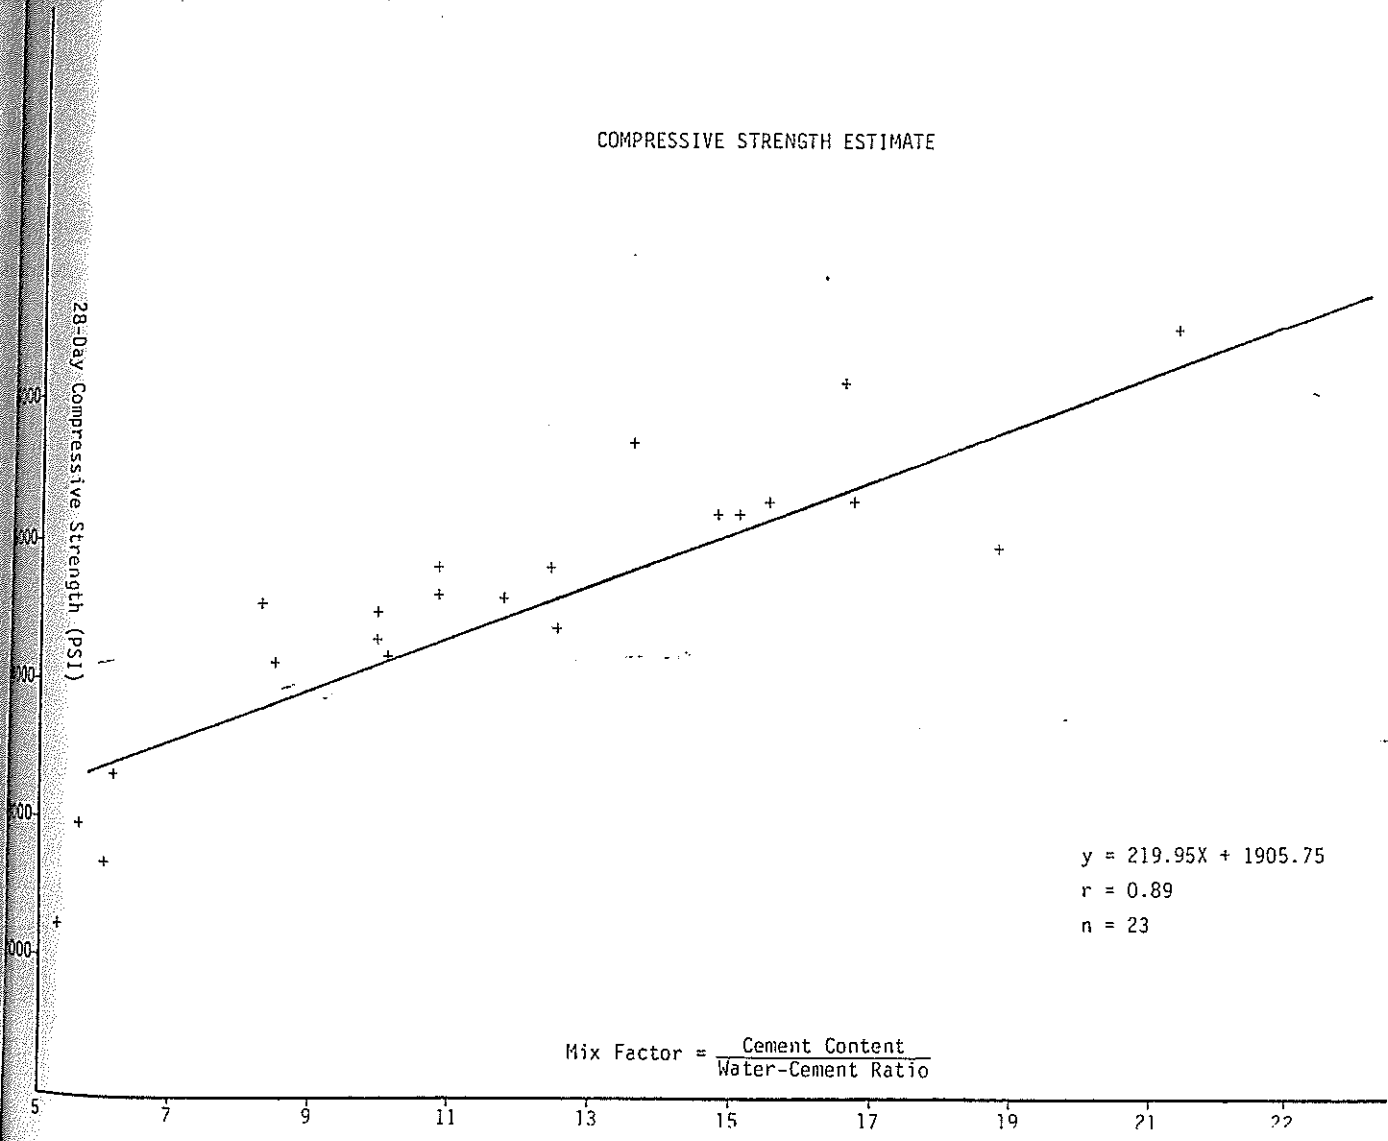

28-Day Strength Versus Mix Factor

FIGURE 21